

**KERAJAAN MALAYSIA**  
**MAJLIS SUKAN NEGARA**  
**DOKUMEN SEBUT HARGA**

**KERJA-KERJA PEMBAIKAN YANG MELIBATKAN  
DINDING DARI JENIS ‘ALUMINIUM LOUVERS’  
SERTA YANG BERKAITAN DENGANNYA DI DRY  
GIM MSN BUKIT JALIL, KUALA LUMPUR**

**NO. SEBUT HARGA : .....**



**KETUA PENGARAH  
MAJLIS SUKAN NEGARA MALAYSIA  
KOMPLEKS SUKAN NEGARA  
BUKIT JALIL, SRI PETALING  
57000 KUALA LUMPUR**



No. Tawaran Sebutharga : \_\_\_\_\_  
Nama Tawaran Sebutharga : \_\_\_\_\_  
  
Tarikh Tutup : \_\_\_\_\_  
Cadangan Tempoh Siap/Penyerahan : - \_\_\_\_\_

BAHAWASANYA, saya mengaku bahawa butir-butir dan keterangan yang diberikan di bawah ini mengenai perniagaan/syarikat saya adalah betul dan benar, maka Kerajaan boleh mengambil apa-apa tindakan terhadap saya di bawah apa-apa undang-undang yang berkuatkuasa

1. **Maklumat Penyebutharga**

a) Nama Penyebutharga : \_\_\_\_\_  
b) Nama Syarikat : \_\_\_\_\_  
c) Alamat Syarikat / Penyebutharga : \_\_\_\_\_  
  
d) **Email (Wajib diisi)** : \_\_\_\_\_  
e) No. H/P : \_\_\_\_\_

2. **No. Pendaftaran Syarikat dengan Suruhanjaya Syarikat Malaysia (SSM) dan Kementerian Kewangan Malaysia (MOF)**

(Sila lampirkan Sijil)

3. **Taraf Syarikat** : Bumiputra / Bukan Bumiputra / Sendirian Berhad /Berhad/ Perkongsian/ Milikan Tunggal

4. **Jenis Perniagaan** : \_\_\_\_\_

5. **Bilangan Pekerja** : \_\_\_\_\_

- a) Pengurusan  
b) Profesional  
c) Teknikal  
d) Sokongan


6. **Maklumat Pemilik dan Pengurusan Syarikat**

- a) Ahli-ahli Lembaga Pengarah

Nama	Jawatan	Peratus Pegangan Saham (%)

b) Ahli-ahli Pengurusan dan Profesional

Kategori Jawatan	Bilangan Pekerja
JUMLAH	

7. Kedudukan Modal

- (a) Modal Dibenarkan :  
 (b) Modal Dibayar :

**(sila lampirkan satu (1) salinan BAKI penyata akaun bank syarikat yang terkini)**

- (c) Kedudukan Saham Dalam Peratus

- |  |   |       |   |
|--|---|-------|---|
| (i) Bumiputra                          | : | ----- | % |
| (ii) Bukan Bumiputra                   | : | ----- | % |
| (iii) Modal Asing (Foreign Investment) | : | ----- | % |
| (iv) Dalam Negeri                      | : | ----- | % |

8. Pengalaman Dalam Bekalan/Perkhidmatan/Kerja Yang Berkaitan

Sila Senaraikan jenis bekalan/perkhidmatan/kerja dalam tempoh **tiga (3) tahun** terkini. (Jika ruang tidak mencukupi, sila sertakan lampiran).

Jenis Bekalan/ Perkhidmatan/Kerja	Nama Kerajaan/ Swasta	Nilai	Tempat	Tempoh/One Off

Saya akui bahawa butir-butir di atas adalah betul dan benar:

Tandatangan -----  
 Nama Penyebutharga -----  
 Jawatan -----  
 Tarikh -----

Borang Tawaran Harga dan Borang Maklumat Penyebutharga perlu cop syarikat dan ditandatangani oleh pihak syarikat.

**Borang ini WAJIB diisi dengan LENGKAP dan sebarang kegagalan pengisian maklumat boleh menyebabkan tawaran sebutharga terbatal**

**NOTA: Dokumen yang telah lengkap hendaklah di klip atau tebuk lubang 2 sahaja (JANGAN GUNA BINDING/PELEKAT)**

**KERJA-KERJA PEMBAIKAN YANG MELIBATKAN DINDING DARI JENIS ‘ALUMINIUM LOUVERS’ SERTA YANG BERKAITAN DENGANNYA DI DRY GIM MSN BUKIT JALIL, KUALA LUMPUR**

---

**ISI KANDUNGAN**

<b><u>NO</u></b>	<b><u>PERKARA</u></b>	<b><u>MUKA SURAT</u></b>
1	SENARAI SEMAKAN	SM/1-2
2	ARAHAN KEPADA PENYEBUTHARGA	Page 1 – Page 7
3	SURAT AKUAN PEMBIDA (SAP bertarikh 1 April 2010) <b>LAMPIRAN A1</b>	SAP/1
4	SYARAT-SYARAT SEBUT HARGA	Page 8 – Page 14
5	BORANG SEBUT HARGA	BSH/1
6	SENARAI KUANTITI	
7	SPESIFIKASI	A/1 – B/17
8	REKOD PENGALAMAN KERJA DALAM 5 TAHUN LEPAS – BORANG D	BRG-D/1
9	SENARAI KAKITANGAN TEKNIKAL – BORANG E	BRG-E/1
10	KEEMPUNYAAN LOJI DAN PERALATAN UTAMA – BORANG F	BRG-F/1
11	PRESTASI KERJA SEMASA a) BORANG G b) BORANG GA c) BORANG GA1	BRG-G/1 BRG-GA/1 BRG-GA1/1
12	SENARAI SUB-KONTRAKTOR PAKAR – BORANG H	BRG-E/1-2
13	LUKISAN TAPAK BINA	

---

# **SENARAI SEMAKAN**

### SENARAI SEMAK

Sila Tandakan  bagi Dokumen-dokumen yang disertakan.

Bil	Perkara/ Dokumen	Untuk di tanda oleh Syarikat	Untuk di tanda oleh Jawatankuasa Pembuka Sebut Harga
1	Salinan Sijil Perolehan Kerja Kerajaan (SPKK)		
2	Salinan Perakuan Pendaftaran Kontraktor (PPK)		
3	Salinan Sijil Taraf Bumiputera (STB) - PKK		
4	Salinan Penyata Akaun Bank (3 Bulan) Terkini Yang Disahkan Oleh Pihak Bank		
5	Borang Sebut Harga telah diisi dengan lengkap (termasuk nilai tawaran dan tempoh siap) dan ditandatangani oleh Penama seperti tertera dalam Sijil Pendaftaran dari CIDB/PKK (BSH/1)		
6	Ringkasan Sebut Harga telah diisi dengan lengkap (RSR/1)		
7	Senarai Kerja 5 tahun yang telah disiapkan (BRG-D/1)		
8	Senarai Kakitangan Teknikal (BRG-E/1)		
9	Senarai Keempunyaan Loji dan Peralatan Utama (BRG-F/1)		
10	Prestasi Kerja Semasa (BRG-G/GA/GA1)		
11	Senarai Sub-Kontraktor Pakar (BRG-H/1-2)		
12	Profil Syarikat (Lengkap dan Sempurna)		
13	Surat Akuan Pembida (Lampiran A1)		
14	Maklumat Penyebutharga		
15	Addenda Sebutharga (jika berkaitan)		
16	Lain-lain sekiranya ada: .....		

**PENGESAHAN OLEH SYARIKAT**

Dengan ini saya mengesahkan bahawa saya telah membaca dan memahami semua syarat-syarat dan terma yang dinyatakan di dalam dokumen sebut harga. Semua maklumat yang dikemukakan adalah benar.

Tandatangan:

Nama:

Jawatan:

Tarikh:

**UNTUK KEGUNAAN MAJLIS SUKAN NEGARA**

Jawatankuasa Pembuka Sebut Harga mengesahkan penerimaan dokumen bertanda kecuali bagi perkara bil.....(jika ada).

Tandatangan:

Nama:

Jawatan:

Tarikh:

Tandatangan:

Nama:

Jawatan:

Tarikh:

---

# **ARAHAN KEPADA 彭年裕**

---

## **ARAHAN KEPADA PENYEBUT HARGA**

### **1. HAK KERAJAAN UNTUK MENERIMA / MENOLAK SEBUT HARGA**

Kerajaan adalah tidak terikat untuk menerima sebut harga yang terendah atau mana-mana sebut harga atau memberi apa-apa sebab di atas penolakan sesuatu sebut harga. Keputusan Jawatankuasa Sebut Harga adalah muktamad.

### **2. CARA-CARA MELENGKAPKAN DOKUMEN SEBUT HARGA**

#### **2.1. Penyediaan Sebut Harga**

Kontraktor adalah dikehendaki mengisi dengan dakwat segala maklumat berikut dengan sepenuhnya:-

- (a) Harga dan tandatangan Kontraktor di Ringkasan Sebut Harga,
- (b) Harga, tempoh dan tandatangan dalam Borang Sebut Harga,
- (c) Senarai Kerja Dalam Tangan,
- (d) Senarai Kerja Pengalaman 5 Tahun,
- (e) Senarai Kakitangan Teknikal,
- (f) Senarai Loji dan Peralatan Utama,
- (g) Jadual Kadar Harga (jika ada),
- (h) Butir-butir Spesifikasi (jika ada),
- (i) Surat Akuan Pembida.
- (j) Jika berlaku kesilapan dalam mengisi maklumat-maklumat di atas Penyebut Harga hendaklah menandatangani ringkas semua pembetulan.
- (k) Kegagalan mengisi/menandatangani Borang Sebut Harga akan mengakibatkan Sebut Harga ditolak.
- (l) Sekiranya terdapat percanggahan di antara maklumat yang dinyatakan dalam Ringkasan Sebut Harga dan Borang Sebut Harga, maklumat di dalam Borang Sebut Harga diberi keutamaan.
- (m) Sekiranya Penyebut Harga didapati memberikan maklumat palsu atau sengaja menyorok atau tidak memberikan mana-mana maklumat yang memberikan kesan negatif terhadap keupayaannya, Sebut Harganya akan ditolak dan tindakan tatatertib akan diperakukan terhadapnya.

---

**2.2. Dokumen-dokumen lain yang mesti dikemukakan (Dokumen Wajib/Sokongan)**

- (a) Salinan Sijil Perolehan Kerja Kerajaan (SPKK)
- (b) Salinan Sijil Perakuan Pendaftaran Kontraktor (PPK)
- (c) Salinan Sijil Taraf Bumiputera (PKK)
- (d) Senarai sub-kontraktor pakar (jika berkaitan)

**2.3. Penyerahan Dokumen Sebut Harga**

- (a) Dokumen Sebut Harga yang telah diisi dengan lengkap hendaklah dimasukkan ke dalam sampul surat berlakri yang dicatatkan dengan bilangan Sebut Harga ..... serta tajuk sebut harga dan hendaklah dimasukkan ke dalam peti sebut harga pada masa dan tempat yang ditetapkan dalam Notis Sebut Harga.
- (b) Jika Dokumen Sebut Harga tidak diserahkan dengan tangan, Penyebut Harga hendaklah menghantar Dokumen tersebut secara pos berdaftar supaya tiba pada atau sebelum masa dan di tempat yang ditetapkan seperti berikut :

**Lobi (Aras Bawah),  
Majlis Sukan Negara Malaysia,  
Kompleks Sukan Bukit Jalil,  
Seri Petaling,  
57000 Kuala Lumpur**

**sebelum jam 12.00 tengahari**

- (c) Sebut Harga yang diserahkan selepas masa yang ditetapkan, berbangkit atas sebarang sebab, tidak akan dipertimbangkan.

**2.4. Penjelasan Lanjut**

Sekiranya terdapat maklumat dalam Dokumen Sebut Harga yang tidak jelas atau bercanggah, Penyebut Harga boleh menghubungi pejabat yang menjual/mengeluarkan Dokumen Sebut Harga untuk penjelasan lanjut.

---

#### 2.5. Tandatangan Oleh Penyebutharga

Sebutharga hendaklah ditandatangan oleh pegawai yang ditauliahkan oleh syarikat seperti penama yang dinyatakan dalam Sijil Perolehan Kerja Kerajaan (SPKK) yang dikeluarkan oleh CIDB, Pusat Khidmat Kontraktor (PKK) atau PUKONSA/ UPKJ yang mana berkenaan.

### 3. TEMPOH SIAP KERJA

Kerja ini hendaklah disiapkan dalam tempoh tidak melebihi **12 Minggu**. Mana penyebut harga yang menawarkan tempoh siap kerja melebihi tempoh siap kerja maksimum yang ditetapkan tidak akan dipertimbangkan.

### 4. BAYARAN DOKUMEN SEBUT HARGA

- \* Dokumen Sebut Harga ini adalah **PERCUMA** atau;
- \* ~~Dokumen Sebut Harga ini dijual dengan harga RM.....(Ringgit Malaysia : ..... sahaja)~~

Note

\* Potong tidak berkenaan

### 5. PERBELANJAAN PENYEDIAAN SEBUT HARGA

Semua Perbelanjaan bagi penyediaan sebut harga ini hendaklah ditanggung oleh Penyebut Harga sendiri.

### 6. TEMPOH SAH SEBUT HARGA

Sebut Harga ini sah selama sembilan puluh (90) hari dari tarikh tutup sebut harga. Penyebut harga tidak boleh menarik balik sebut harganya sebelum tamat tempoh sah sebut harga. Tindakan tatatertib akan diambil sekiranya penyebut harga menarik balik sebut harganya sebelum tamat sah sebut harga. Laporan mengenai penarikan balik Sebut Harga oleh penyebut harga akan dikemukakan kepada CIDB/BPKU untuk tindakan.

---

## 7. PELAKSANAAN INTEGRITY PACT DALAM PEROLEHAN KERAJAAN

Penyebut harga wajib mengemukakan **Surat Akuan Pembida** bersama-sama dengan Dokumen Sebutharga di mana penyebut harga berwaad untuk tidak akan menawarkan atau memberi rasuah kepada mana-mana individu lain sebagai sogokan untuk dipilih dalam sebut harga tersebut. Surat Akuan Pembida ini hendaklah dilengkapkan dan ditandatangani oleh Pegawai Syarikat yang ditauliahkan.

Surat Akuan Pembida tersebut adalah menjadi salah satu dokumen mandatori dalam penilaian sebut harga peringkat pertama. Sekiranya penyebut harga gagal mengemukakan **Surat Akuan Pembida** yang telah dilengkapkan dan ditandatangani, penyebut harga tersebut akan dinilai sebagai gagal dalam penilaian peringkat pertama (gagal kriteria mandatori sebut harga) dan penilaian seterusnya tidak akan dilaksanakan.

Penyebut harga yang berjaya wajib mengemukakan **Surat Akuan Pembida Berjaya** beserta dengan Borang Perjanjian Inden Kerja/Surat Setuju Terima yang telah ditandatangani di mana ia berwaad tidak akan memberi rasuah sebagai ganjaran kerana mendapatkan kontrak. Surat Akuan ini akan menjadi sebahagian daripada Kontrak.

Pemalsuan maklumat dokumen dan rekod untuk mengaburi penilaian perolehan adalah kesalahan jenayah dan boleh disabitkan di bawah Kanun Keseksaan (Akta 574).

---

## 8. DASAR CUKAI JUALAN DAN CUKAI PERKHIDMATAN (CJCP)

Kerajaan memutuskan untuk melaksanakan Cukai Jualan dan Cukai Perkhidmatan (CJCP) bagi menggantikan Cukai Barang dan Perkhidmatan (GST) mulai 1 September 2018 berdasarkan Akta Cukai Jualan 2018 [Akta 806] dan Akta Cukai Perkhidmatan 2018 [Akta 807].

Akta Cukai Jualan 2018 [Akta 806] dan Akta Cukai Perkhidmatan 2018 [Akta 807] telah berkuat kuasa mulai 1 September 2018. Selaras dengan peruntukan dalam Akta tersebut, perolehan kerja pembinaan tidak dikenakan Cukai Perkhidmatan. Bagi perolehan kerja lain antaranya pengurusan fasiliti dan lain-lain, Agensi Kerajaan hendaklah merujuk kepada Jadual Pertama di bawah Peraturan Cukai Perkhidmatan 2018 dan peraturan semasa yang berkuat kuasa.

Agensi Kerajaan hendaklah menggunakan anggaran jabatan tanpa kenaan CJCP untuk menentukan kaedah perolehan.

---

Bagi pengeluaran Surat Setuju Terima (SST), Agensi hendaklah merujuk kepada 1PP/PK4.2 atau pekeliling berkaitan SST yang berkuat kuasa.

Bagi memastikan urusan perolehan dan pembayaran dapat dilaksanakan dengan lancar selaras dengan perkembangan dan peraturan terkini, satu panduan perlu disediakan.

## 9. PERINGATAN MENGENAI KESALAHAN RASUAH

Semua Penyebut Harga adalah diingatkan supaya tidak terlibat dalam aktiviti jenayah rasuah berkaitan dengan perolehan ini. Sehubungan dengan itu, para Penyebut Harga diberi peringatan berikut:

- 9.1 Sebarang perbuatan atau percubaan rasuah untuk menawar atau memberi, meminta atau menerima apa-apa suapan secara rasuah kepada dan daripada mana-mana orang berkaitan perolehan ini merupakan satu kesalahan jenayah di bawah Akta Suruhanjaya Pencegahan Rasuah Malaysia 2009 (Akta 694).
- 9.2 Sekiranya mana-mana pihak ada menawar atau memberi apa-apa suapan kepada mana-mana anggota perkhidmatan awam, maka pihak yang ditawar atau diberi suapan dikehendaki membuat aduan dengan segera ke pejabat Suruhanjaya Pencegahan Rasuah atau balai polis yang berhampiran. Kegagalan berbuat demikian adalah merupakan suatu kesalahan di bawah Akta Suruhanjaya Pencegahan Rasuah Malaysia 2009 (Akta 694).
- 9.3 Tanpa prejudis kepada tindakan-tindakan lain, tindakan tatatertib terhadap anggota perkhidmatan awam dan menyenaraihitamkan Kontraktor boleh diambil sekiranya pihak-pihak terlibat dengan kesalahan rasuah di bawah Akta Suruhanjaya Pencegahan Rasuah Malaysia 2009 (Akta 694).
- 9.4 Mana-mana Kontraktor yang membuat tuntutan bayaran berkaitan perolehan ini walaupun tiada kerja dibuat mengikut spesifikasi yang ditetapkan dan mana-mana anggota perkhidmatan awam yang mengesahkan tuntutan berkenaan adalah melakukan kesalahan di bawah Akta Suruhanjaya Pencegahan Rasuah Malaysia 2009 (Akta 694).

---

## **10. PEMATUHAN AKTA 342 DAN NORMA BAHRU DALAM SEKTOR PEMBINAAN DAN DALAM MENANGANI EPIDEMIK DAN PANDEMIK COVID 19**

- 10.1 Penyebutharga yang berjaya dikehendaki mematuhi Akta Pencegahan dan Pengawalan Penyakit Berjangkit 1988 (Akta 342) dan semua Garis Panduan dan Prosedur Operasi Piawai yang berkaitan dalam menangani Epidemik dan Pandemik seperti wabak Covid 19 yang dikeluarkan oleh Kementerian Kesihatan Malaysia, CIDB dan Jabatan Kerja Raya Malaysia.
- 10.2 Penyebutharga dikehendaki mengambilkira dalam harga tawaran untuk pematuhan perkara 60.1.
- 10.3 Kegagalan mematuhi Akta, Garis Panduan dan Prosedur Operasi Piawai yang telah ditetapkan menyebabkan tindakan boleh di ambil oleh agensi agensi yang berkenaan dan sebarang tuntutan akibat tindakan ini tidak akan dipertimbangkan

## **11. ADDENDA SEBUTHARGA**

- 11.1 Sebelum tarikh akhir bagi penyerahan sebutharga, Jabatan/Agenzi boleh mengeluarkan Addenda Sebutharga untuk menerangkan, membetulkan, mengurangkan atau membuat tambahan mana-mana bahagian Kandungan dokumen sebutharga. Semua Addenda Sebutharga akan dikeluarkan secara rasmi kepada semua penyebutharga melalui Jabatan/Agenzi yang memanggil sebutharga.
- 11.2 Setiap Addenda Sebutharga yang dikeluarkan akan diedarkan kepada semua penyebutharga dan akan menjadi sebahagian daripada dokumen sebutharga. Penerimaan setiap Addenda Sebutharga hendaklah diakui melalui Borang Bukti Penerimaan yang disertakan bersama-sama Addenda Sebutharga. Borang Bukti Penerimaan bagi Addenda Sebutharga yang terlibat hendaklah dikembalikan bersama-sama dengan dokumen sebutharga bagi tujuan penilaian dan tindakan selanjutnya. Ianya menjadi sebahagian daripada syarat wajib dalam proses penilaian sebutharga yang dilakukan. Kegagalan berbuat demikian boleh menyebabkan sebutharga berkenaan ditolak.
- 11.3 Penyebutharga hendaklah juga mengesahkan penerimaan semua Addenda Sebutharga yang dikeluarkan dalam Senarai Semakan Mengemukakan Sebutharga. Kegagalan berbuat demikian boleh menyebabkan sebutharga berkenaan ditolak. Semua Addenda Sebutharga yang dikeluarkan adalah menjadi sebahagian dari Kontrak.
- 11.4 Penyebutharga hendaklah mengambil tindakan sewajarnya terhadap apa-apa maklumat atau arahan yang dinyatakan dalam Addenda Sebutharga.

---

## 12. HARGA INDIKATIF JABATAN

- 12.1 Harga Indikatif Jabatan bagi sebutharga ini adalah Ringgit Malaysia : **TIGA RATUS LIMA PULUH SAHAJA (RM350,000.00)**
  - 12.2 Harga Indikatif Jabatan ini merupakan suatu anggaran sahaja dan amaun tersebut tidak mengikat Kerajaan atau mana-mana pihak lain juga bagi maksud mengelakkan kekeliruan yang mungkin berbangkit.
  - 12.3 Pihak Kerajaan tidak menjamin bahawa syarikat akan dipilih atau boleh menyiapkan kerja dengan bersandarkan Harga Indikatif Jabatan.
-

---

# **SURAT AKUAN PEMBIDA**



## MAJLIS SUKAN NEGARA MALAYSIA

### *Ke Arah Kecemerlangan Sukan*

#### SURAT AKUAN PEMBIDA

Saya, ..... No. Kad Pengenalan ..... yang mewakili  
(Nama Syarikat: ..... nombor Pendaftaran .....  
dengan ini mengisyiharkan bahawa saya atau mana-mana individu yang mewakili syarikat ini  
tidak akan menawar atau memberi **rasuah** kepada mana-mana individu dalam .....  
atau mana-mana individu lain, sebagai sogokan untuk dipilih dalam tender/sebutharga\* seperti di atas. Bersama ini dilampirkan Surat Perwakilan Kuasa bagi saya  
mewakili syarikat seperti tercatat untuk membuat pengisyiharan ini.

2. Sekiranya saya, atau mana-mana individu yang mewakili syarikat ini didapati cuba  
menawar atau memberi **rasuah** kepada mana-mana individu dalam .....  
atau mana-mana individu lain sebagai sogokan untuk dipilih dalam tender/sebutharga\*  
seperti di atas, maka saya sebagai wakil syarikat bersetuju tindakan-tindakan berikut diambil:

Penarikan balik tawaran kontrak bagi tender/sebutharga\* di atas; atau  
Penamatan kontrak bagi tender/sebutharga\* di atas; dan  
Lain-lain tindakan tatatertib mengikut peraturan perolehan kerajaan yang berkuatkuasa.

3. Sekirana terdapat mana-mana individu cuba meminta **rasuah** daripada saya atau mana-mana individu yang berkaitan dengan syarikat ini sebagai sogokan untuk dipilih dalam tender/sebutharga\* seperti di atas, maka saya berjanji akan dengan segera melaporkan perbuatan tersebut kepada Suruhanjaya Pencegahan Rasuah Malaysia (SPRM) atau balai polis yang berhampiran.

Yang Benar

.....

Nama :

No. K/p:

Cop syarikat:

Catatan: i) \*Potong mana yang tidak berkenaan.  
ii) Surat akuan ini hendaklah dikemukakan bersama Surat Perwakilan Kuasa

---

# **SYARAT<sup>2</sup> SEBUT HARGA**

---

## **SYARAT-SYARAT SEBUT HARGA**

### **1. PEMERIKSAAN TAPAK BINA**

Kontraktor disifatkan telah memeriksa dan meneliti tapak bina dan sekitarnya, bentuk dan jenis tapak bina, takat dan jenis kerja, bahan dan barang yang perlu bagi menyiapkan kerja, cara-cara perhubungan dan laluan masuk ke tapak bina dan hendaklah mendapatkan sendiri segala maklumat yang perlu tentang risiko, luar jangkaan dan segala hal-keadaan yang mempengaruhi dan menjelas sebut harganya. Sebarang tuntutan yang timbul akibat daripada kegagalan Kontraktor mematuhi kehendak ini tidak akan dipertimbangkan.

### **2. INSURANS**

- 2.1. Kontraktor hendaklah atas nama bersama Kerajaan dan Kontraktor mengambil Insurans Liabiliti Awam dan Insurans Kerja (sekiranya dinyatakan di dalam Butir-butir Ringkasan Sebut Harga) bagi tempoh pelaksanaan Kerja termasuk tempoh kecacatan dan ditambah tiga (3) bulan dan empat belas (14) hari. Kontraktor hendaklah juga mengemukakan Nombor Kod Pendaftaran dengan PERKESO.
- 2.2. Kontraktor hendaklah mengemukakan kepada Pegawai Inden semua polisi insurans dan Nombor Kod Pendaftaran dengan PERKESO yang tersebut di atas sebelum memulakan Kerja. Bagaimanapun untuk tujuan memulakan Kerja sahaja Nota-nota Perlindungan dan resit-resit bayaran premium adalah mencukupi. Sekiranya Kontraktor gagal mengemukakan semua polisi insurans selepas tempoh sah nota-nota perlindungan, tanpa sebarang sebab yang munasabah, Pegawai Inden berhak mengambil tindakan.

### **3. BON PELAKSANAAN**

Bon Pelaksanaan dikekualikan bagi perolehan yang bernilai sehingga **RM200,000.00**.

### **4. PERATURAN PERLAKSANAAN KERJA**

- 4.1. Kerja-kerja yang dilaksanakan hendaklah mematuhi Spesifikasi, pelan-pelan, butir-butir kerja dalam Ringkasan Sebut Harga dan Syarat-syarat yang dinyatakan dalam Dokumen Sebut Harga ini dan Pegawai Inden atau Wakilnya.

- 
- 4.2. Kerja-kerja elektrik yang dilaksanakan di samping mematuhi kehendak di perenggan 4.1 di atas, hendaklah juga mematuhi semua peraturan dan pekeliling, undang-undang dan undang-undang kecil yang diluluskan oleh:
- 4.2.1. Suruhanjaya Tenaga
  - 4.2.2. Jabatan Keselamatan Pekerjaan dan Kesihatan (JKKP)
  - 4.2.3. Pemegang Lesen dan Pihak Berkuasa Bekalan Elektrik
  - 4.2.4. Jabatan Bomba dan Penyelamat
  - 4.2.5. Pihak Berkuasa Tempatan
  - 4.2.6. Suruhanjaya Pengurusan Air Negara (SPAN)

## 5. KEGAGALAN KONTRAKTOR MEMULAKAN KERJA

Sekiranya Kontraktor gagal memulakan kerja selepas tujuh (7) hari dari tarikh akhir tempoh mula kerja yang dinyatakan dalam Inden, tanpa sebab-sebab yang munasabah, Inden akan dibatalkan oleh Pegawai Inden dan tindakan tatatertib akan diambil terhadap kontraktor.

## 6. SUB-SEWA DAN MENYERAH HAK KERJA

Kontraktor tidak dibenarkan mengsub-sewakan Kerja kepada Kontraktor-kontraktor lain. Kontraktor tidak boleh menyerah hak apa-apa faedah di bawah Inden ini tanpa terlebih dahulu mendapatkan persetujuan bertulis daripada Pegawai Inden.

## 7. PENOLAKAN BAHAN, BARANG DAN MUTU HASIL KERJA OLEH PEGAWAI INDEN

- 7.1. Pegawai Inden atau Wakilnya berhak menolak bahan, barang dan mutu hasil kerja dari jenis piawaian yang tidak menepati seperti diperihalkan dalam spesifikasi. Kontraktor hendaklah, apabila diminta oleh Pegawai Inden, memberi kepadanya baucar-baucar dan/ atau perakuan ujian pengilang untuk membuktikan bahawa bahan-bahan dan barang-barang itu mematuhi spesifikasi. Bahan, barang dan kerja-kerja yang ditolak hendaklah diganti dan sebarang kos tambahan yang terlibat hendaklah ditanggung oleh Kontraktor sendiri.
- 7.2. Kontraktor hendaklah dengan sepenuhnya atas perbelanjaan sendiri menyediakan sampel bahan dan barang-barang untuk ujian.
- 7.3. Tiada penggantian untuk peralatan, bahan dan cara kerja yang telah ditentukan di dalam spesifikasi atau ditawarkan dan telah diterima, dibenarkan kecuali mendapat persetujuan daripada Pegawai Inden secara bertulis.

---

## **8. RINGKASAN SEBUT HARGA**

- 8.1. Ringkasan Sebut Harga hendaklah menjadi sebahagian daripada Borang Sebut Harga ini dan hendaklah menjadi asas Jumlah Harga Sebut Harga.
- 8.2. Harga-harga dalam Ringkasan Sebut Harga hendaklah mengambil kira semua kos termasuk kos pengangkutan, cukai, duti, levi, bayaran dan caj-caj lain yang perlu dan berkaitan bagi penyiapan Kerja dengan sempurnanya.
- 8.3. Tiada sebarang tuntutan akan dilayan bagi pelarasan harga akibat daripada perubahan kos buruh, bahan-bahan dan semua duti dan cukai kerajaan, sama ada dalam tempoh sah sebut harga atau dalam tempoh Kerja.
- 8.4. Harga-harga dalam ringkasan Sebut Harga yang dikemukakan oleh Kontraktor hendaklah tertakluk kepada persetujuan sebelumnya itu daripada Pegawai Inden tentang kemunasabahannya. Persetujuan sebelumnya itu dan apa-apa pelarasan kemudiannya kepada harga-harga dalam Ringkasan Sebut Harga hendaklah dibuat sebelum Inden Kerajaan dikeluarkan.
- 8.5. Apa-apa pelarasan harga dalam Ringkasan Sebut Harga menurut perenggan 8.4 tersebut di atas dan apa-apa kesilapan hisab dalam Ringkasan Sebut Harga hendaklah dilaraskan dan diperbetulkan sebelum Inden Kerajaan dikeluarkan. Jumlah amaun yang dilaraskan hendaklah sama dengan amaun jumlah harga pukal dalam Borang Sebut Harga. Amaun jumlah harga pukal dalam Borang Sebut Harga hendaklah tidak berubah.
- 8.6. **Sekiranya sebut harga berasaskan senarai kuantiti sementara, pengukuran semula hendaklah dibuat dan harga sebut harga diselaraskan.**

## **9. PERCANGGAHAN DAN KECUKUPAN DOKUMEN SEBUT HARGA**

- 9.1. Borang Perjanjian Inden Kerja, Surat Akuan Pembida Berjaya yang ditandatangani oleh Kontraktor dan Dokumen Sebut Harga hendaklah disifatkan menjadi dan dibaca serta ditafsirkan sebagai sebahagian daripada Kontrak ini.
- 9.2. Dokumen Sebut Harga adalah dikira sebagai saling jelaskan antara satu sama lain. Kontraktor hendaklah mengadakan segala yang perlu untuk melaksanakan kerja dengan sewajarnya sehingga siap mengikut tujuan dan maksud sebenar. Dokumen Sebut Harga pada keseluruhannya sama ada atau tidak tujuan dan maksud itu hendaklah difahamkan dengan munasabahnya dari Dokumen Sebut Harga itu.

---

9.3. Jika Kontraktor mendapati apa-apa percanggahan dalam Dokumen Sebut Harga dia hendaklah merujuk kepada Pegawai Inden untuk mendapatkan keputusan.

**10. KEGAGALAN KONTRAKTOR MENYIAPKAN KERJA DAN PENAMATAN PERLANTIKAN KONTRAKTOR**

Pegawai Inden berhak membatalkan Inden sekiranya Kontraktor berada dalam keadaan berikut dan setelah menerima surat amaran daripada Pegawai Inden:

- (a) Kontraktor masih gagal menyiapkan Kerja dalam tempoh masa yang telah ditetapkan;
- (b) Kemajuan Kerja terlalu lembap di mana Kontraktor didapati gagal menjalankan kerja dengan tekun dan teratur tanpa apa-apa sebab yang munasabah;
- (c) Penggantungan pelaksanaan seluruh atau sebahagian Kerja, tanpa apa-apa sebab yang munasabah;
- (d) Tidak mematuhi arahan Pegawai Inden tanpa apa-apa alasan yang munasabah;
- (e) Pegawai Inden berhak membatalkan Inden sekiranya Kontraktor diisyiharkan bankrap oleh pihak yang sah.

**11. BAYARAN PENDAHULUAN**

Bayaran pendahuluan dibenarkan bagi kontrak yang bernilai melebihi RM 200,000.00 hingga RM 500,000.00

**12. BAYARAN INTERIM/ KEMAJUAN**

Pegawai Inden dibenarkan membuat bayaran interim sehingga kerja-kerja siap dilaksanakan.

---

### **13. KERJA PERUBAHAN**

- 13.1. Pegawai Inden boleh menurut budi bicaranya mengeluarkan arahan-arahan yang berkehendakkan sesuatu perubahan kerja dengan secara bertulis. Tiada apa-apa perubahan yang dikeluarkan oleh Pegawai Inden atau yang disahkan kemudian oleh Pegawai Inden boleh membatalkan Sebut Harga ini.
- 13.2. Semua kerja perubahan dan/ atau tambahan yang diluluskan oleh Pegawai Inden akan diukur atau dinilai dengan menggunakan kadar harga yang ada dalam Senarai Kuantiti/ Ringkasan Sebut Harga. Jika tidak terdapat sebarang kadar harga yang bersesuaian, kadar harga yang dipersetujui oleh Pegawai Inden dan Kontraktor hendaklah digunakan.

### **14. PENGUKURAN KUANTITI SEMENTARA**

Setelah kerja-kerja yang melibatkan Kuantiti Sementara disiapkan di tapak, pengukuran semula kuantiti hendaklah dibuat secara bersama.

### **15. LANJUTAN MASA**

Pelanjutan masa adalah tertakluk kepada Jawatankuasa Sebut Harga terlebih dahulu.

### **16. TEMPOH TANGGUNGAN KECACATAN (DLP)**

- 16.1. Tempoh Tanggungan Kecacatan bagi sebut harga hendaklah sekurang-kurangnya enam (6) bulan dari tarikh kerja diperakukan siap. Bagi kerja-kerja mekanikal dan elektrikal di mana tempoh waranti ke atas alat-alat dan loji-loji adalah dua belas (12) bulan dan dalam kes-kes tertentu oleh sebab jenis dan kerumitan kerja, tempoh tanggungan kecacatan yang lebih lama daripada enam bulan (6) boleh dikenakan.
- 16.2. Kontraktor dipertanggungjawabkan untuk membaiki kecacatan, ketidak sempurnaan, kekecutan atau apa-apa juga kerosakan lain seperti yang mungkin kelihatan dan yang disebabkan oleh bahan atau barang atau mutu hasil kerja yang tidak menepati sebut harga ini apabila diarahkan oleh Pegawai Inden dan dalam masa yang berpatutan. Kontraktor hendaklah membaiki kecacatan, ketidak sempurnaan, kekecutan atau apa-apa juga kerosakan lain atas Kos Kontraktor sendiri.

- 
- 
- 16.3. Sekiranya Kontraktor gagal membaiki kecacatan, ketidaksempurnaan, kekecutan atau apa-apa juga kerosakan lain seperti yang diarahkan, Pegawai Inden berhak memotong kos membaiki dari baki wang yang akan dibayar kepada kontraktor atau, jika baki itu tiada mencukupi, mengeluarkan surat pengesyoran kepada Lembaga Pembangunan Industri Pembinaan Malaysia (CIDB) dan Pusat Khidmat Kontraktor (PKK) untuk menggantungkan pendaftaran Kontraktor, dan menghantar salinan-salinan tersebut kepada Pengarah Kerja Raya Negeri/ Ketua Jabatan, Bahagian Pembangunan Bumiputera, Kementerian Kerja Raya dan Lembaga Pembangunan Industri Pembinaan. Bagi Kerja-kerja elektrik/ mekanikal, salinan surat hendaklah dihantar kepada Pengarah Cawangan Kerja Elektrikal/ Pengarah Cawangan Kerja Mekanikal.
  - 16.4. Tempoh tanggungan liabiliti kecacatan (DLP) sepertimana yang dinyatakan pada Surat Iringan Kepada Inden Kerajaan/Surat Setuju Terima iaitu bermula dari tarikh diambil milik dan penyerahan projek.

## **17. PERATURAN MEMBAYAR SELEPAS SIAP**

Bayaran sepenuhnya hanya akan dibayar setelah kontraktor menyiapkan kerja dengan sempurnanya dan Perakuan Siap Kerja dikeluarkan. Walaubagaimanapun Pegawai Inden hendaklah membuat potongan atau menahan sejumlah amaun dari wang yang akan dibayar kepada Kontraktor sebagai kos untuk membaiki apa-apa kecacatan yang tidak dapat dibaiki oleh Kontraktor di dalam tempoh tanggungan kecacatan. Kontraktor hendaklah mengembalikan Inden Kerajaan (Pelaksanaan Kerja) dan Inden Kerajaan (Penyiapan Kerja) sepertimana yang telah ditetapkan dalam Pekeliling Perbendaharaan Malaysia (PK 4.2) kepada Pegawai Inden.

## **18. PERAKUAN SIAP KERJA**

Pegawai Inden hendaklah mengeluarkan Perakuan Siap Kerja sebaik sahaja kerja disiapkan dengan sempurna dan memuaskan sejajar dengan syarat-syarat Dalam Dokumen Sebut Harga. Tempoh Tanggungan Kecacatan bermula daripada tarikh siap kerja.

## **19. PERAKUAN SIAP MEMPERBAIKI KECACATAN**

Pegawai Inden hendaklah mengeluarkan Perakuan Siap Membaiki Kecacatan sebaik sahaja kontraktor telah membaiki kecacatan, ketidaksempurnaan, kekecutan atau apa-apa juga kerosakan lain.

---

**20. PEMATUHAN KEPADA UNDANG-UNDANG OLEH KONTRAKTOR**

Kontraktor hendaklah mematuhi segala kehendak Undang-undang Kecil dan Undang-undang Berkanun dalam Malaysia semasa pelaksanaan Kerja. Kontraktor tidak berhak menuntut sebarang kos dan bayaran tambahan kerana pematuhananya dengan syarat-syarat ini.

**21. PENAMATAN BERSABIT RASUAH, AKTIVITI MENYALAHİ UNDANG-UNDANG ATAU AKTIVITI HARAM**

Tanpa menjelaskan apa-apa hak Kerajaan yang lain, jika kontraktor, personel, kakitangan atau pekerjaanya disabitkan bersalah oleh mahkamah kerana rasuah atau aktiviti menyalahi undang-undang atau aktiviti haram yang berkait dengan Perjanjian/ Kontrak ini atau mana-mana perjanjian lain yang Kontraktor mungkin ada dengan Kerajaan, Kerajaan berhak untuk menamatkan Perjanjian / Kontrak ini pada bila-bila masa, dengan memberi notis bertulis dengan segera yang membawa maksud sedemikian kepada Kontraktor.

Setelah penamatan tersebut, Kerajaan berhak terhadap semua kerugian, kos, ganti rugi dan perbelanjaan (termasuk apa-apa kos dan perbelanjaan sampingan) yang ditanggung oleh Kerajaan yang timbul daripada penamatan tersebut.

Bagi mengelakkan keraguan, kedua-dua pihak Kerajaan dan Kontraktor bersetuju bahawa Kontraktor tidak layak terhadap sebarang bentuk kerugian termasuk kehilangan keuntungan, ganti rugi, tuntutan atau apa sekalipun setelah penamatan Kontrak ini.

**22. PERAKUAN KERJA TIDAK SIAP**

Pegawai Inden hendaklah mengeluarkan Perakuan Kerja Tidak Siap apabila penyiapan Kerja didapati telah terlambat dan sebab kelambatan tidak melayakkan Kontraktor mendapat lanjutan masa, maka kerugian atau ganti rugi yang dialami oleh Kerajaan akibat daripada kelambatan tersebut adalah ditanggung oleh Kontraktor. Kerugian atau ganti rugi yang dialami oleh Kerajaan akan diperolehi semula daripada Kontraktor melalui Ganti Rugi Tertentu dan Ditetapkan.

---

**23. KENAAN DENDA/TOLAKAN/ LIQUIDATED AND ASCERTAINED DAMAGE (LAD) BAGI SEBUT HARGA KERJA**

Kelewatan dalam menyiapkan projek boleh menyebabkan peningkatan kos projek. Jika syarikat gagal memenuhi obligasi kontrak, denda/ganti rugi hendaklah dituntut daripada syarikat. Jika syarikat gagal membayarnya, denda/ganti rugi hendaklah dituntut daripada bayaran kemajuan atau daripada sebarang baki bayaran yang syarikat berhak menerima.

\* Pengenalan LAD boleh ditetapkan berdasarkan formula seperti berikut :

$$\text{LAD} = \frac{\text{Base Landing Rate (BLR)}}{100} \times \frac{\text{Harga Kontrak}}{365 \text{ (hari)}}$$

\* 'Prime Rate' yang dikeluarkan oleh mana-mana bank perdagangan

---

# **BORANG SEBUT HARGA**

## BORANG SEBUTHARGA

Sebutharga Bil :.....

**BAHAGIAN KEWANGAN .....**  
**MAJLIS SUKAN NEGARA .....**  
**KOMPLEKS SUKAN BUKIT JALIL .....**  
**SERI PETALING .....**  
**57000 KUALA LUMPUR .....**  
**MALAYSIA .....**

Tuan,

Sebut Harga untuk :-

**KERJA-KERJA PEMBAIKAN YANG MELIBATKAN DINDING DARI JENIS 'ALUMINIUM LOUVERS' SERTA YANG BERKAITAN DENGANNYA DI DRY GIM MSN BUKIT JALIL, KUALA LUMPUR**

Di bawah dan tertakluk kepada Arahan Kepada Penyebut Harga, Syarat-syarat Sebutharga untuk kerja, Spesifikasi Kerja dan Lukisan, saya yang bertandatangan di bawah ini adalah dengan ini menawarkan untuk melaksanakan dan menyiapkan kerja-kerja tersebut bagi jumlah harga pukal sebanyak Ringgit Malaysia:

.....(RM .....)

2. Saya bersetuju menyiapkan kerja-kerja ini dalam masa ..... minggu dari tarikh mula kerja seperti yang ditetapkan di bawah Perenggan 2 Borang Perjanjian Inden Kerajaan.

Bertarikh pada ..... haribulan ..... 20.....

( Tandatangan Kontraktor )

Nama Penuh : .....  
No. K/P : .....  
Alamat : .....  
.....  
Atas sifat : .....

( Tandatangan Saksi )

Nama Penuh : .....  
No. K/P : .....  
Alamat : .....  
.....

Meteri atau Cap Kontraktor

---

## **SENARAI KUANTITI**

## RINGKASAN SEBUTHARGA

BIL	SPESIFIKASI KERJA	JUMLAH	
		RM	SEN
1.	KERJA-KERJA PEMBAIKAN YANG MELIBATKAN DINDING DARI JENIS 'ALUMINIUM LOUVERS' SERTA YANG BERKAITAN DENGANNYA DI DRY GIM MSN BUKIT JALIL, KUALA LUMPUR		
	1. KERJA-KERJA AWALAN		
	2. KERJA-KERJA PEMASANGAN DINDING BARU		
	3. KERJA-KERJA PEMBUANGAN 'ALUMINIUM FOIL'		
	4. MEMBEKAL DAN MEMASANG BUMBUNG AWNING 'POLYCARBONATE'		
	5. PEMBAIKAN KECIL		
	Jumlah		

Ringgit Malaysia :

\_\_\_\_\_  
Tandatangan Penyebutharga

\_\_\_\_\_  
Tandatangan Saksi

\_\_\_\_\_  
Nama Penyebutharga

\_\_\_\_\_  
Nama Saksi

\_\_\_\_\_  
No. K/P Penyebutharga

\_\_\_\_\_  
No. K/P Saksi

\_\_\_\_\_  
Jawatan

\_\_\_\_\_  
Jawatan

\_\_\_\_\_  
Cop Syarikat

Alamat:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Alamat:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Telephone :  
Facsimile :

Telephone :  
Facsimile :

**PERHATIAN :**

Sebarang pertanyaan boleh dimajukan kepada ;

**MUHAMAD FAEZAL MD NOH**  
(Bahagian Fasiliti Sukan)  
Tel : 03-89929600/89929837  
Fax : 03-90583380

**Nota :**

1. Kontraktor dinasihatkan melihat sendiri tapak cadangan untuk mengetahui selok-belok kerja.
2. Harga tawaran sah selama 3 bulan dari tarikh tutup panggilan sebutharga dibuat.
3. Bersama-sama ini juga sila lampirkan profile syarikat untuk rujukan.
4. Majlis tidak terikat dengan mana-mana sebutharga yang terendah.

.....  
( Tandatangan Kontraktor )

Nama : \_\_\_\_\_  
Cop/Alamat : \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

No. Tel. : \_\_\_\_\_  
No. Fax. : \_\_\_\_\_

**KERJA-KERJA PEMBAIKAN YANG MELIBATKAN DINDING DARI JENIS 'ALUMINIUM LOUVERS' SERTA  
YANG BERKAITAN DENGANNYA DI DRY GYM MSN BUKIT JALIL, KUALA LUMPUR**

BIL	BUTIRAN KERJA	UNIT	KUANTITI	KADAR HARGA (RM) / KUANTITI	JUMLAH (RM)
<b>1.</b>	<b><u>KERJA-KERJA AWALAN</u></b>				
1.1	Kerja-kerja permulaan (Preliminaries) mengikut spesifikasi am, spesifikasi tambahan termasuk Insurans Tanggungan Awam, Insurans Kerja, Insurans Pampasan Kerja dengan membayar premium atau nombor pendaftaran PERKESO bagi semua pekerja.	Pukal	Pukal		
1.2	Menyediakan pekerja, peralatan keselamatan dan kebersihan semasa kerja-kerja sedang dijalankan seperti tali-tali halangan, kon, tanda amaran dan tali merah-putih sehingga kerja-kerja disiapkan mengikut arahan Pegawai Pengguna.	Pukal	Pukal		
1.3	Menyediakan laporan foto kemajuan kerja (sebelum, semasa dan selepas) sebanyak dua (2) set bewarna pada setiap tuntutan bayaran (Hard copy & soft copy – dalam thumb drive).	Pukal	Pukal		
1.4	Mengadakan dan menyediakan tong sampah mudah alih menggunakan lori mengikut kesesuaian tapak bagi menampung kapasiti sampah agar kebersihan tapak adalah sentiasa terjamin . Sampah sarap ini perlu dibawa keluar daripada tapak bina yang diluluskan oleh pihak berkuasa tempatan apabila penuh atau di atas arahan Pegawai Pengguna.	Pukal	Pukal		
1.5	Pihak kontraktor mestilah memindahkan segala peralatan sedia ada ke kawasan yang sesuai dan memindahkan semula termasuk kemasan ke tempat yang diarahkan oleh pihak MSNM	Pukal	Pukal		
<b>2.</b>	<b><u>KERJA-KERJA PEMASANGAN DINDING BARU 'ALUMINIUM LOUVERS'</u></b>				
2.1	Menyediakan pekerja mahir/buruh, kelengkapan, bahan dan jentera bagi kerja-kerja membekal dan memasang penghadang 'Aluminium louvers' dengan bingkai 75mm lebar dan sisip angin dan diperkemaskan dengan ribet dan besi penguat.	M2	450		
2.2	Kerja-kerja memasang besi hollow 2"x4" Panjang 4.9-meter untuk menahan dinding 'Aluminium louvers' sedia ada, 15 petak diskru dengan 2 lubang besi luar dan dalam termasuk membaikpulih 'Aluminium louvers' sediada	NO	60		
2.3	Kerja-kerja memasang baru 'Aluminium louvers' untuk bahagian atas tepi bangunan. Ukuran : 14 meter x 1.5 meter x (2 bahagian)	M2	42		

3.	<b><u>KERJA-KERJA PEMBUANGAN 'ALUMINIUM FOIL'</u></b>				
3.1	Menyediakan pekerja mahir/buruh, kelengkapan, bahan dan jentera bagi membuka serta membuang 'Aluminium foil' di keseluruhan bahagian di dalam bangunan. Ukuran 14 meter x 80 meter.	M2	1,120		
4.	<b><u>MEMBEKAL DAN MEMASANG BUMBUNG AWNING 'POLYCARBONATE'</u></b>				
4.1	Menyediakan pekerja mahir/buruh, kelengkapan, bahan dan jentera bagi kerja-kerja membuka bumbung awning 'Polycarbonate' sedia ada yang pecah dan rosak, sediakan tempat bagi menerima pemasangan bumbung awning 'Polycarbonate' yang baru lengkap kekemasan serta kerja-kerja yang berkaitan dengannya Ukuran : 1 meter x 2.5 meter.	M2	40		
5.	<b><u>PEMBAIKAN KECIL</u></b>				
5.1	Kerja-kerja baikpulih kerosakan tandas dan kerja perpaipan serta berkaitan dengannya.	Pukal	Pukal		
5.2	Kerja-kerja membaikpulih peralatan elektrik dan pendawaian serta kerja berkaitan dengannya.				
	1. Lampu 'Spotlight' LED	No	20		
	2. Kipas Dinding	No	10		
	3. Suis Lampu 'Spotlight'	Pukal	Pukal		
<b>JUMLAH KESELURUHAN</b>					

**Notis makluman :-**

\*Kadar Kuantiti Yang Dinyatakan Dalam Sebutharga Ini **HANYALAH ANGGARAN UKURAN KUANTITI SEMENTARA**. Pihak Penyebutharga Dinasihatkan Membuat Ukuran Sendiri Di Tapak\*

---

# **SPESIFIKASI**

## TABLE OF CONTENT

<b>SECTION E: WALL SYSTEM</b>	<b>PAGE</b>
1. General	E/1
2. Products, components and proprietary systems	E/3
3. Type of Finishes to Walls and Partitions	E/7
4. Structural Wall (Blockwork System)	E/7
5. Samples and Mock-up	E/9
6. Walling / Construction	E/10

 <b>JKR MALAYSIA</b>	<b>SECTION E: WALL SYSTEM</b>	No. Dokumen : JKR 20800-0226-20 No. Keluaran : 01 No. Pindaan : 00 Tarikh : 02 Januari 2020 Muka Surat : E/1
--	-------------------------------	--

## 1. General

- 1.1. Non-structural wall (NSW) system hereby refers to vertical building element designed as non-loadbearing internal wall which serve with functions as cited in Uniform Building By-Laws (UBBL), and not being a party wall inside a building.
- 1.2. Non-structural wall system shall refer to solid wall, lightweight drywall partition, pre-cast/pre-fabricated panels, etc.
- 1.3. Structural wall (SW) system hereby refers to vertical building element designed as loadbearing internal wall which serve with functions as cited in Uniform Building By-Laws (UBBL) and being a party wall inside a building.
- 1.4. Structural wall system shall refer to blockwork system stated in sub-section 4..
- 1.5. Unless otherwise specified, all non-structural walls or infill walls shall be constructed using proprietary blocks. Building materials considered for non-structural wall construction may refer to sub-section 2. below. Each material type shall comply with the respective standard or manufacturer's specification. Build-up or configuration of NSW shall be strictly based on recommendations or/and design by solution provider.
- 1.6. Unless otherwise specified, design considerations of NSW shall take into consideration the following functional features, any one or in combination, and comply with relevant parts of the current Building Code:
  - 1.6.1. Structural stability. This includes consideration of external loadings, if any such as lateral wind or traffic pressure, heavy fixtures etc.;
  - 1.6.2. Thermal & fire resistance;
  - 1.6.3. Water resistance;
  - 1.6.4. Acoustic performance; and
  - 1.6.5. Impact resistance.
- 1.7. Design for Wall Performances
  - 1.7.1. Loading
    - 1.7.1.1. All NSW shall be constructed only for their intended purposes and any additional loadings shall be referred to the S.O. for approval.
    - 1.7.1.2. Proprietary internal lightweight partition, including secondary framing shall be designed to meet specification requirement to ensure structural sufficiency and safety. The governing factor shall be based upon allowable deflection limit shall be of L/240 or L/360 @ 250Pa or equivalent design code. L refers to height of wall in metre (m). 250Pa refers to lateral uniform pressure applying perpendicular to wall surface.
  - 1.7.2. Thermal and Fire Rating
    - 1.7.2.1. Material used for wall construction shall be classified as Class O building material in accordance with BS 476 Part 4 (non-combustible) or Part 6 & 7 (limited combustible), or at least has an A2 rating in accordance with EN 13501 Part 1.



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/2

1.7.2.2. Unless otherwise specified or shown on the Drawings, fire rated walls and partitions system shall be constructed and calculated according to requirements and approval of the DGFR and compliance to the Uniform Building By-Law (UBBL).

1.7.2.3. The glass wool, stone wool and cellulose insulation materials used shall comply with BS 476 - Fire tests on building materials and structures:

Part 4 : Non-combustibility test for materials;

Part 6 : Method of test for fire propagation for products; and

Part 7 : Method of test to determine the classification of the surface spread of flame of products.

### 1.7.3. Water proofing

Where necessary, NSW shall be properly treated with proprietary water proofing system as per respective manufacturer's recommendation, along with warranty coverage if applicable.

### 1.7.4. Acoustic rating

1.7.4.1. Where necessary, NSW shall be designed to have specific sound insulation rating in accordance with ISO or equivalent as below:

ISO 140-3 – Laboratory measurements of airborne sound insulation of building elements; and

ISO 717-1 – Acoustics – Rating of sound insulation in buildings and of building elements – Part 1: Airborne sound insulation.

1.7.4.2. Unless otherwise specified, designing architect shall determine the required acoustic performance for the wall structure based on intended usage.

### 1.7.5. Security and impact rating

1.7.5.1. Where applicable, wall shall be designed with some degree of security and impact resistance feature. While solid wall structure is naturally to have high impact resistance capability, for drywall partition this shall be evaluated in accordance with BS 5234: Partitions (including matching linings) – Part 2: Specification for performance requirements for strength and robustness including methods of test, or equivalent.

1.7.5.2. Where necessary, designing architect shall decide grade of duty rating for wall structure making reference to recommendation in Table 1 – Partition grades by categories of duty in BS 5324: Part 2.



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/3

## 2. Products, components and proprietary systems

### 2.1. Cement

The cement, unless otherwise described, shall be CEM 1 complying with MS EN 197-1 and as specified under SECTION D: CONCRETING.

### 2.2. Sand

Sand for mortar shall comply with MS EN 12620 and as specified in SECTION D: CONCRETING.

### 2.3. Mortar

2.3.1. Mortar shall consist of one (1) part of cement to six (6) parts of sand, with the addition of an approved mortar plasticizer used strictly in accordance with manufacturer's recommendation. The ingredients for mortar shall be measured in proper gauge boxes and shall be mixed on a clean boarded platform or in an approved mechanical batch mixer.

2.3.2. All mortar shall be used within forty-five (45) minutes of mixing and no remaking up of mortar shall be permitted thereafter.

2.3.3. Mortar for brickwork below damp proof course or ground floor level shall be in the proportion of one part of cement and three parts of sand.

### 2.4. Damp Proof Course

2.4.1. Unless otherwise shown on the Drawings, bituminous damp proof courses shall comply with BS 8215: Code of practice for design and installation of damp-proof courses in masonry construction. The bitumen damp proof membrane shall be two (2) ply with a nominal mass of 1840g/m<sup>2</sup>.

2.4.2. Bitumen damp proof course shall be in rolls to suit the thickness of walls or brickwork. The damp proof course shall be bedded on a level bed of cement mortar (1:1) and lapped at least 150mm or the width of the damp proof course at running joints and intersections.

2.4.3. In all cases of doubt as to the exact location of the damp proof course, the Contractor shall refer to the S.O. before laying the damp proof course. The damp proof course above ground shall be continuous for the whole length and thickness of the wall and be at least 150mm above finished ground level to prevent moisture from the ground rising through the foundation to the wall above ground, which otherwise would make wall surfaces damp and damage wall finishes.

### 2.5. Bricks and Blocks

#### 2.5.1. General

All brick walls shall have G.I expanded/exmet mesh reinforcement with 750mm x 5mm diameter brickwork dowel bar complete with 75mm right angle bent to hook onto brickwork at every 4th course.

#### 2.5.2. Samples

Separate samples of each type of bricks and blocks taken at random from the load, shall be submitted to the S.O. for approval before the bricks and blocks



<b>SECTION E: WALL SYSTEM</b>	No. Dokumen : JKR 20800-0226-20 No. Keluaran : 01 No. Pindaan : 00 Tarikh : 02 Januari 2020 Muka Surat : E/4
-------------------------------	--

are used. All subsequent deliveries shall generally be up to the standard of the samples approved. No soft, broken, twisted or otherwise defective bricks and blocks will be permitted to be used.

#### 2.5.3. Clay Bricks

All ordinary clay bricks shall be machine-made, wire cut and shall be hard, well burnt, sound, square and clean all in accordance with MS 76.

#### 2.5.4. Cement Sand Bricks and Hollow Blocks

2.5.4.1. All cement sand bricks and hollow blocks shall comply with MS 27.

2.5.4.2. The dimensions of blocks shall comply with MS 1064.

2.5.4.3. Wherever blocks are used, a modular sized block shall be used and constructed in accordance with the manufacturer's standards, requirements and method statements.

2.5.4.4. The composition of cement sand bricks and hollow blocks shall consist of a uniform mixture of sand and cement. The sand cement shall be mixed in the ratio of six (6) parts of sand to one (1) part of cement by volume in a mechanical mixer capable of taking one (1) bag of cement (50 kg of cement shall be taken as 0.035 cube). The sand used shall be as described hereinbefore and the maximum size shall pass through a 4.8 mm mesh BS sieve. The cement used shall be CEM 1 as described under SECTION D: CONCRETING.

2.5.4.5. The Contractor shall only use cement sand bricks and hollow blocks supplied by approved manufacturer.

2.5.4.6. The minimum permissible average compressive strength shall be 5.2N/mm<sup>2</sup> for bricks and 2.8N/mm<sup>2</sup> for hollow blocks per 10 samples taken at random from the Contractor's stock pile of 1000 or part thereof. All rejected or condemned bricks shall be removed from site at the Contractor's expense.

#### 2.5.5. Light Weight Concrete Block

2.5.5.1. Light weight concrete blocks shall comply with BS EN 6073-1 and shall be used and laid strictly in accordance with the manufacturer's instructions.

2.5.5.2. Light weight concrete blocks shall be free from asbestos or toxic substances.

2.5.5.3. Where light weight concrete blocks are used in lieu of clay bricks, a modular sized block shall be used according to manufacturer's standards, requirements and method statements.

2.5.5.4. The light weight concrete blocks shall have the following performance criteria:

Dry density of between 500kg/m<sup>3</sup> and 1500kg/m<sup>3</sup>;

Dimensional accuracy of ± 1.5mm on all faces;



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/5

The permissible compressive strength shall be not less than 7N/mm<sup>2</sup> per 10 samples taken at random from the contractor's stock pile of 1000 or part thereof and tested at certified lab;

Ultimate tensile strength shall be 0.44 - 0.55 Mpa;

Thermal resistance (R-value) of not less than 1m<sup>2</sup>K/W; and

Minimum working density for the blocks is 910kg/m<sup>3</sup>.

- 2.5.5.5. The infill wall thickness of light weight blocks shall be as follows:

100mm thickness for internal walls;

125mm thickness for external walls;

200mm thickness (fire rated) for party wall; and

Internal spaces with 24 hour air-condition should comply with the thermal resistance R-value of not less than 1m<sup>2</sup>K/W.

### 2.6. Patented and Proprietary Brick and Block

- 2.6.1. Patented bricks and blocks shall comply with MS 2282 and shall be used and laid strictly in accordance with the manufacturer's instructions.

#### 2.6.2. Cement Brick (Patented or Proprietary)

- 2.6.2.1. The cement brick wall partition system shall satisfy the performance requirements specified in Clause 5 of BS 476: Part 22, for non-load bearing wall partition for the following periods:

Integrity : 130 minutes

Insulation : 130 minutes

- 2.6.2.2. Minimum compressive strength shall be not less than 7 N/mm<sup>2</sup>.

- 2.6.3. All patented or proprietary brick and block wall installation works shall strictly adhere to the manufacturer's method statement for installation works and to S.O.'s approval.

### 2.7. Large Prefabricated Panels.

Large prefabricated panels when used shall conform to MS 1313 and shall be installed strictly in accordance with the manufacturer's recommendations.

### 2.8. Gypsum Plasterboard

- 2.8.1. Gypsum plasterboard sheeting shall be a complete proprietary system, in accordance with the Product Data, approved sample and the relevant Standards.

- 2.8.1.1. BS EN 15283 (Series): Gypsum boards with fibrous reinforcement  
- Definitions, requirements and test methods; dan

- 2.8.1.2. BS EN 520: Gypsum plasterboards - Definitions, requirements and test methods.



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/6

- 2.8.2. Provide moisture-resistant, impact-resistant, fire-resistant and acoustic-rated plasterboard systems where indicated or required.
  - 2.8.2.1. Moisture-resistant grade (MR) plasterboard shall be suitable proprietary products for use in moisture-resistant construction in wet areas where normal plasterboard would be unsuitable.
  - 2.8.2.2. Fire-resistant grade (FR) plasterboard shall be suitable proprietary products for fire-resistant construction.
  - 2.8.2.3. Impact-resistant grade (IR) plasterboard shall be suitable proprietary products for construction of system requiring robustness feature.

### 2.9. Fibre Cement Sheet

- 2.9.1. Fibre-cement (FC) sheeting shall be a complete proprietary system, asbestos-free, in accordance with the Product Data, approved samples, and the relevant Standards.
  - 2.9.1.1. MS 1224: Specification for fibre cement symmetrically corrugated sheet and fittings - product specification and test method; and
  - 2.9.1.2. MS 1296: Fibre-cement flat sheets- product specification and test methods.

### 2.10. Insulation (Acoustical and Thermal)

- 2.10.1. Unless otherwise specified or shown on the Drawings, acoustic wall panel and/or systems shall be constructed and calculated according to requirements of acoustic specialist and approved by S.O.'s approval.
- 2.10.2. Thermal insulation system shall comply with MS1020. Samples of the insulation material shall be submitted to the S.O. for approval before they are used and subsequent delivery shall be up to the standard of samples approved.
- 2.10.3. Unless otherwise shown in the Drawings, glass wool insulation shall be made in Malaysia 50mm thick. It shall have a conductive value of maximum 0.035 W/m<sup>2</sup>K (tested at a mean temperature of 20°C based MS1020 tested according to ASTM C518). Unless otherwise specified the size of the glass wool insulation shall be 600mm x 1200mm. Glass wool insulation shall be fixed in accordance with the manufacturer's recommendation and to the approval of the S.O..
- 2.10.4. Where stone wool insulation is to be used, it shall be made in Malaysia 50mm thick. It shall have a conductive value of maximum 0.035 W/m<sup>2</sup>K (tested at a mean temperature of 20°C based MS1020 tested according to ASTM C518). Unless otherwise specified the size of the stone wool insulation shall be 600mm x 1200mm. Stone wool insulation shall be fixed in accordance with the manufacturer's recommendation and to the approval of the S.O..
- 2.10.5. The contractor shall submit the COO (certificate of origin) confirming made in Malaysia from the supplier/manufacturer to the S.O for approval prior to the commencement of the works. No installation works shall commence until approval is given in writing by the S.O..



## SECTION E: WALL SYSTEM

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : 02 Januari 2020  
Muka Surat : E/7

2.10.6. Recommended type of spray applied cellulose insulation shall be:

- 2.10.6.1. Thickness - 30mm;
- 2.10.6.2. Thermal conductivity (k-value) = 0.0029 W/m·K tested to ASTM C-177;
- 2.10.6.3. Fire retardant Class "O" complying with BS476 Part 6 & 7 and endorsed by FRDM;
- 2.10.6.4. Average moisture absorption of not more than 15% as per ASTM C739;
- 2.10.6.5. Tested Noise Reduction Coefficient of NRC 0.75 at 30mm thickness; and
- 2.10.6.6. Tested to be non-toxic and asbestos free, contain no carcinogenic materials and shall not cause any skin irritation to humans.

### 3. Type of Finishes to Walls and Partitions

- 3.1. Unless otherwise shown in the Drawings, all plastering works for brick walls shall include the wall surface area above ceiling finish level.
- 3.2. Unless otherwise specified or shown on the drawings, the appropriate type of finishes for walls and partitions shall be as specified in the Schedule of Finishes. Unless otherwise shown on the Drawings or described in the B.Q., The finishes and their dimensions shall be as specified in SECTION K: PLASTERING, PAVING, TILING AND CARPET and SECTION O: PAINTING.

### 4. Structural Wall (Blockwork System)

This clause shall apply to the construction of all load bearing blockworks with or without steel reinforcement. All lines, levels, grades, dimensions and cross-sections shall be as shown on the Drawings and/or directed by the S.O.. The full requirement is outlined in the *Specification for Load Bearing Blockwork System (JKR 20601-0252-18)* or the latest edition published by JKR.

#### 4.1. Material

The block shall comply with the requirements of MS 2282 Part 3.

#### 4.2. Compressive Strength

For all block units intended to be used in elements subject to structural requirements, the mean compressive strength shall not be less than 7N/mm<sup>2</sup>. The manufacturer shall also declare the normalised compressive strength when relevant.

#### 4.3. Density

The net dry density of the units shall be declared in kilogram per cubic meters (kg/m<sup>3</sup>) by the manufacturer in accordance with MS 1933 Part 13. The minimum dry density of unit shall not be less than 1500kg/m<sup>3</sup>.



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/8

### 4.4. Structural Mortar

- 4.4.1. Recommended minimum compressive strength for prescribed mortar shall be class M6. The proportion of materials by volume shall be referred to **TABLE E1**.
- 4.4.2. The compressive strength of masonry mortar shall be determined in accordance with BS EN 1015 Part 11. The adhesion between the mortar and the masonry units shall be adequate for the intended use. The ingredients for mortar shall be measured in proper gauge boxes and shall be mixed on a clean boarded platform or in an approved mechanical batch mixer.
- 4.4.3. The characteristic compressive strength of masonry bonded with thin layer mortar shall be taken as the values given for mortar strength class M12 (mortar designation (i) in **TABLE E1**). The contractor shall submit the manufacturer's specification and method statement to the S.O. for approval prior to the commencement of works.

### 4.5. Mortar Testing

The use of mortars shall be in accordance with the recommendation given in BS EN 1996. When samples are taken from a designed mortar in accordance with BS EN 1015 Part 2 and tested in accordance with BS EN 1015 Part 11, the compressive strength of the mortar shall not be less than the specified compressive strength. **TABLE E1** shows the relationship of compressive strength classes and the compressive strength of mortar at 28 days.

### 4.6. Concrete Infill

Concrete infill for reinforced masonry shall be of minimum grade C25/30 (designed mix) or 30P (prescribed) with 10mm nominal size aggregates and specified in accordance with MS 523 Part 2. The minimum cement content, maximum free water/cement ratio and the concrete cover shall conform to the requirement in **Table E2**.

### 4.7. Blocklaying

- 4.7.1. Unless otherwise specified, all blockworks shall be laid on a full bed of mortar, and vertical joints shall be filled up fully. The average thickness of the vertical and horizontal joints shall be 10mm, exclusive of any key in the jointing surfaces of the units.
- 4.7.2. Unless specified, as work proceeds do not rack back corners and other advanced work higher than 1.2m above the general level. For facing work complete the whole lift within one period of operation. Except where permitted by a proprietary system or by the designer, do not carry up any one leaf more than 1.5m height in one day.

### 4.8. Block Masonry Bonds

The running or stretcher bond of blocks are shown in **FIGURE E1** and **FIGURE E2**.

### 4.9. Services Holes and Chases

- 4.9.1. In order to eliminate unnecessary cutting away and making good, sleeves and chases should be provided during the erection of the masonry. In external walls, all sleeves and pipes should preferably be laid with a fall toward the



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/9

outside. The installation of services should be completed before plastering or other finishing work is begun.

- 4.9.2. Where chases have to be cut, suitable power tools which do not operate by heavy impact should be used so that the recommended depth is not exceeded. Fixing units (blocks) where required, should be built into the wall or partition in the correct positions for skirting, rails and other items of joinery, fittings, etc.
- 4.9.3. In walls or leaves constructed of solid units, the depth of horizontal chases should not exceed one-sixth of the thickness of the single leaf at any point whilst the depth of the vertical chases should not normally exceed one-third of the thickness of the single leaf at any point.
- 4.9.4. The cutting of holes up to approximately 300mm square in the wall to accommodate items of equipment may be permitted.
- 4.9.5. Where heavy fittings are to be fixed to a wall, the effect on the stability of the masonry should be considered.

## 5. Samples and Mock-up

- 5.1. Samples and mock-up of wall construction shall be provided and approved by the S.O. prior to the commencement of the actual construction works. The size of the samples shall be determined by the S.O..
- 5.2. The samples and mock-up for walls and partitions shall include connections between the following components where applicable:
  - 5.2.1. Floor to floor to a minimum of 5m length;
  - 5.2.2. Wall corners;
  - 5.2.3. Lintels;
  - 5.2.4. Stiffeners;
  - 5.2.5. Door and window frames; and
  - 5.2.6. All other walls between different materials.
- 5.3. Sample and Mock-Up Panels for Structural Wall (Blockwork System)
  - 5.3.1. The contractor shall construct a mock-up panel for the project with total build-up area more than 100m<sup>2</sup> using load bearing blockworks system.
  - 5.3.2. Sample panels shall be built on site in a protected position to provide an agreed standard for the work and treatment of joints before the commencement of the works subjected to the S.O. approval. Such panels shall be maintained throughout the contract and removed on completion.
  - 5.3.3. The mock-up panel needs to be constructed to expose not less than 2m length x 1m height, selected as follows:



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/10

### 6. Walling / Construction

#### 6.1. Brick Walling

- 6.1.1. Unless otherwise specified or shown on the Drawings, the whole of the brickwork shall be constructed with standard size clay bricks in mortar as described and the surface left ready for plastering.
- 6.1.2. All clay bricks shall be soaked in a suitable tank or pit to be provided by the Contractor for at least half an hour before being laid and shall be kept wet whilst being laid. The top of walls left off shall be thoroughly wet before work is resumed. All constructed walling must be left wet and properly protected from the direct sunlight during the following day. The Contractor shall provide sufficient means to ensure that this is done.
- 6.1.3. Cement sand bricks shall not be soaked but dipped in water before being laid and all constructed brickwork shall be protected from direct sunlight during the day on which it is laid and also during the following day and the contractor shall provide sufficient means to ensure that this is done.
- 6.1.4. All bricks shall be properly bedded in mortar and all joints shall be thoroughly flushed up and raked out to a depth of 13mm as the works proceeds. No joint shall exceed 10mm in thickness.
- 6.1.5. Brickwork shall be carried up perfectly true and plumb in a uniform manner. No one portion being raised more than 1m above another at one time. No overhand work shall be permitted, and scaffolding shall be carried up as the work proceeds. The vertical points of every alternate course shall be kept perpendicular over one another, and all perpends, quoins, et cetera shall be kept strictly true and square.
- 6.1.6. All intersections and angles of walls shall be properly bonded together, and all walls and piers of lengths not multiples of brick sizes shall be cut and bonded in the best approved manner. No broken bricks shall be used except where required to form bonds.
- 6.1.7. All half brick (113mm) walls shall be reinforced at every fourth course with approved reinforcement (for example exmet) commencing two courses above floor level. For block walling, reinforcement shall be at every second course commencing one course above floor level.
- 6.1.8. All brick walls shall be constructed on reinforced concrete beams in accordance with the Drawings. No brick walls except lightweight partitions are allowed to be constructed on reinforced concrete slabs.
- 6.1.9. Unless otherwise specified, all toilet perimeter walls shall be constructed using clay bricks. Cement sand bricks shall not be used for toilet walls.
- 6.1.10. All half brick walls shall be built in Stretcher Bond.
- 6.1.11. All other brickwork shall be built in English Bond or as shown on the Drawings.

#### 6.2. Facing Brickwork

- 6.2.1. All facing brickwork shall be executed in first quality approved facing bricks in Stretcher or Flemish Bond as shown on the Drawings, properly bonded into any backing walls, piers, et cetera. Joints shall be raked out to a depth of 13



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/11

mm and point up in coloured cement mortar to approved tints, finished with a neat struck weathered joint.

- 6.2.2. Facing brickwork shall be kept perfectly clean and no rubbing down of brickwork will be allowed.

### 6.3. Stonework

- 6.3.1. Unless otherwise shown on the Drawings or described in the B.Q., all stone blocks used shall be of limestone or granite whichever is more readily available within the locality of the Site and shall be free from cracks, fissures or other defects to the approval of the S.O.. The stone blocks shall in general, have their largest faces parallel. Unless otherwise required, the maximum thickness of the stone blocks shall in no case exceed the thickness of the wall or portion of the structure into which it is being built.
- 6.3.2. Stone walling shall be laid random un-coursed or random coursed as shown on the Drawings. Through or bonded stones shall be used at one stone per meter square for random coursed. Where backing brick wall is shown, the through stone shall be properly bonded in such brick wall.
- 6.3.3. Unless otherwise shown on the Drawings, all stonework shall be bedded in cement and sand mortar (1:3) mix and finished with a flushed joint rubbed down with sacking. All interstices between individual stones shall be filled with mortar. Finish to exposed surfaces or random walling shall be hammer-dressed.

### 6.4. Hollow Block Walling

The cement sand block wall shall be laid in the manner specified for brick wall. The hollow block shall not be soaked but dipped in water before laying. The hollow block wall shall be reinforced at every second course with reinforcement commencing one course above floor level.

### 6.5. Autoclaved Aerated Concrete (AAC) Block Walling

- 6.5.1. Where shown on the Drawings and/or described in the B.Q. or as an alternative to clay bricks, the Contractor may use AAC blocks for non-load bearing walls and partitions. The AAC block work shall be constructed strictly in accordance with the manufacturer's recommendations. Any extra cost in connection therewith shall be borne by the Contractor.
- 6.5.2. Only proprietary thin bed adhesive shall be used assembling AAC block wall. The AAC block work shall be installed using an approved thin layer of proprietary thin bed adhesive mortar with minimum flexural strength of 0.44 MPa to all horizontals and perpends. The first course must be made true and level using a normal layer of mortar with thin layer of adhesive to fully seal the perpends. The thin layer of proprietary adhesive shall be applied using notched trowel to obtain an even distribution of adhesive to achieve joint thickness of 2mm to 3mm.
- 6.5.3. A damp-proof course slip-joint membrane shall be laid on top of the floor slab or beams before receiving the mortar bedding to allow for differential movement between the blocks and the supporting structure.
- 6.5.4. The AAC block work shall be laid in a manner that the vertical joint of the lower course shall be staggered at least 100mm relative to the vertical joint of the overlaying course.



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/12

- 6.5.5. Unless otherwise directed and/or shown, where concrete block walls abut concrete faces, the face shall be flushed.
- 6.5.6. Control joints should be built into walls at spacing not greater than 8m centres, and at locations in accordance with manufacturer's recommendation.
- 6.5.7. Care must be taken to keep the walls clean, strictly in accordance with the manufacturer's recommendation. Excess adhesive must be removed progressively.
- 6.5.8. The wall surfaces may be finished with suitable surface coating that has the dual properties of being waterproof and water vapour permeable and shall be applied in accordance with the manufacturer's recommendation.
- 6.5.9. Only proprietary cement plaster of the same AAC block shall be used for external rendering of an external wall. The minimum thickness for the rendering of the external wall shall be 12mm thick.
- 6.5.10. Only proprietary skim coat base and skim coat finish of the same AAC block shall be used for internal wall application. The recommended thickness of the skim coat base shall be between 2 - 4mm thickness and the skim coat finish of an internal wall shall be of 1 - 2mm thickness. Both are coatings shall be applied as a two-coat system and applied according to manufacturer's instruction and to the S.O.'s approval.
- 6.5.11. All AAC block wall installation works shall strictly adhere to the manufacturer's method statement for installation works and to S.O.'s approval.

### 6.6. Parapet and Freestanding Wall

- 6.6.1. Any parapet and freestanding wall consisting of 155mm thick brick wall including plastering on both sides shall only be constructed to a maximum height of 900mm.
- 6.6.2. Where shown on the Drawings, freestanding walls above 900mm in height shall be constructed as per the engineer's detail Drawings or to the S.O.'s approval.
- 6.6.3. Precast reinforced concrete copings shall be constructed on all external parapet and free-standing walls. The reinforced concrete coping shall be laid to fall, complete with 12mm half round throating.
- 6.6.4. Freestanding walls more than 3m length vertically and horizontally shall be constructed with reinforced concrete stiffeners to engineer's detail and with the S.O.'s approval.

### 6.7. Lintel and Stiffener

- 6.7.1. Unless otherwise specified or shown on the Drawings, lintels shall be provided to all openings and to be sized accordingly by the Contractor to the S.O.'s approval.
- 6.7.2. Reinforced concrete stiffeners shall be constructed at every minimum of 3m vertically and horizontally to strengthen brick and block wall system construction according to engineer's detail.



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/13

### 6.8. Fasteners

Unless otherwise shown on the Drawings, fasteners or cramps for frames, metal windows and precast units shall be built in at 1m centres on the vertical side of the frame. Mild steel cramps shall be 25mm x 3mm x 225mm long for fixing wooden frames, etc. One end of the cramp shall be turned up and screwed to back of the frame and the other end shall be split and fish-tailed for building in. Cramps which are to be fixed to concrete shall be embedded in concrete and built into brickwork as the work proceeds.

### 6.9. Cutting

All cuttings such as arches, sinks, setbacks, and projections shall be properly formed. Chases and holes through walls and slabs for the passage of pipes, wiring and the like shall be neatly cut or formed. Upon the installation of the services pipes, the chases and holes through walls shall be properly sealed (Fire Stop) to prevent fire spread as required by the DGFR and UBBL. Where plastering works are done on the cuttings, the surface shall be smooth and seamless.

### 6.10. Partitioning

#### 6.10.1. Timber Framed Partition

- 6.10.1.1. All timber used for the timber stud framings for partition walls shall be as specified in SECTION H: TIMBER, JOINERY AND IRONMONGERY.
- 6.10.1.2. Wall partition consisting of timber frames shall consist of vertical and horizontal studs. The studs shall consist of approved timber hardwood with a minimum size of 50mm x 50mm unless otherwise specified. All horizontal and vertical studs shall be constructed at a maximum nominal spacing of 610mm centres.
- 6.10.1.3. The top most horizontal frame, referred to as the top plate shall be bolted or nailed to the ceiling and continuously erected using timber or metal stiffener securely fixed to the slab to the S.O.'s approval. The timber and metal stiffeners shall be spaced at 1220mm centres maximum.
- 6.10.1.4. The lowest horizontal frame, referred to as the bottom plate, shall be securely fixed using bolts or nails. Unless otherwise advised, all fixing to slabs, M12 expansion bolts shall be used at 1220mm centres maximum with galvanized mild steel strap, or equivalent, to the floor to the S.O.'s approval. All fixings to timber slabs shall be fixed at 600mm centres maximum.
- 6.10.1.5. Unless otherwise specified, dimension for timber panels shall comply with MS 1064.
- 6.10.1.6. Where proprietary timber partitions are used, they shall be constructed in accordance with the manufacturer's recommendations and to the S.O.'s approval.
- 6.10.1.7. Partitions, screens and vent panels, shall be constructed as detailed in the Drawings. Where shown, galvanized welded wire mesh or expanded metal of the required sizes and patterns shall be fixed to vent panels and window openings. The mesh shall be secured in position using rebated and mitred timber battens and screws.



## SECTION E: WALL SYSTEM

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : 02 Januari 2020  
Muka Surat : E/14

### 6.10.2. Metal Framed Partition

6.10.2.1. Steel sections such as, but not limited to metal framing and studs shall comply with ASTM C645, BS EN 14195, BS 7364 or other approved equivalent standards as appropriate, and to the approval of the S.O..

6.10.2.2. Unless otherwise specified, all metal framing for partitions shall be either galvanized or zinc alum coated steel 62mm C-Studs (vertical) and 64mm U-tracks (horizontal) of 0.5mm base metal thickness. The steel stud shall be manufactured from mild steel strip, with material specification complying to either one of the following:

Steel grade Z2 with minimum yield strength of 210N/mm<sup>2</sup> and zinc coating type Z275 minimum, complying with BS EN 10143;

Steel grade G300, with minimum yield strength of 300N/mm<sup>2</sup> and zinc-alum coating type AZ150 minimum, complying with AS 1397.

6.10.2.3. The stud which is to support a joint shall have a minimum fixing face width of 32mm for screw fixing and all other framing members shall not be less than 30mm. Drywall screws shall be at least 10mm longer than total thickness of plasterboards on each side of the partition wall. The plasterboards are laid staggered and fixed to the metal frames using drywall screws not exceeding 300mm centres.

6.10.2.4. The top most U-track (horizontal) shall be screwed to the ceiling and continuously erected using metal stiffener securely fixed to the slab. The metal studs directly supporting plasterboard sheets shall be spaced at 610mm centres maximum. The bottom U-track (horizontal) shall be securely fixed to the floor slab using bolts or screws. Unless otherwise advised, all fixing to slabs, M12 expansion bolts shall be used at 1200mm centres maximum with galvanized mild steel strap to the floor and to the S.O.'s approval.

6.10.2.5. Unless otherwise shown on the Drawings, the partitions shall not be erected more than 3000mm height. Partitions which are more than 3000mm height shall be supported by additional structural members, to structural engineer's detail and S.O.'s approval.

6.10.2.6. Partition above ceiling shall allow for cut out opening for service ducts or trunks and cable trays. The contractor shall coordinate with all subcontractors on the exact location and size of the openings. For fire rated partition, any gaps around any pipe ducts through the partition shall be properly sealed with approved fire/smoke stop system by the fire stopping specialist.

6.10.2.7. If full height partition has to be terminated below ventilation duct route parallel to the partitions, the stud of the partition shall be secured to the support frame of the duct or extended secondary frame support. In such cases, space between the duct and reinforced concrete soffit need not be sealed up, unless it is of fire rated type of partition.

6.10.2.8. The deflection of the metal frame partition system under service condition shall be controlled by the limit for the calculated deflection of the element chosen for the system and its intended use. The



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/15

deflection shall not exceed L/240 or L/360 subject to the finishing material attached to the partition. Any system wall partition selected shall be installed strictly according to the manufacturer's specifications and details to the S.O.'s approval.

### 6.10.3. Plasterboard lining

- 6.10.3.1. The type of plasterboard used shall comply with BS EN 520. The specified plasterboard shall carry class 'O' approval from DGFR. Unless otherwise specified the plasterboards used for the works shall be minimum 12.5mm thick with standard length of 2440mm and shall be free of defects.
- 6.10.3.2. The deviations and tolerances shall be in accordance with BS 8212. When required, the deflection under load shall be determined in accordance with BS EN 520.
- 6.10.3.3. The appropriate type of sealant shall be used for the required type of plasterboard. Elastomeric sealants shall be used at the perimeter of the dry lining or partitioning to provide an airtight construction and to the approval of the S.O..
- 6.10.3.4. Jointing compound shall be of air drying or setting type, in accordance with BS EN 13963, and to the approval of the S.O.. Jointing compound shall be applied as per manufacturer's recommendation and S.O.'s approval. The use of any additives to modify any of the properties of compounds shall not be permitted.
- 6.10.3.5. Jointing tape for plasterboards shall not be less than 48mm wide and not exceeding 60mm in accordance with ASTM C475 or equivalent, and the approval of the S.O..
- 6.10.3.6. Control joints shall be provided for a long continuous run of plasterboard wall spaced at not more than 10m apart.
- 6.10.3.7. Corner beads shall be provided as reinforcement to permit construction of true, concealed angles with gypsum base and panels.
- 6.10.3.8. Provision shall be allowed for the plasterboard partition system to support surface mounted fixtures by incorporating independent support framing hidden behind or exposed on the partition surface to provide adequate and appropriate support and to the approval of the S.O..
- 6.10.3.9. Wherever possible, full length plasterboard sheets shall be used to eliminate the need for sheet end butt joints. Where possible, joints on opposite sides of framing should be arranged to occur between different framing members.
- 6.10.3.10. Plasterboard sheets shall be laid out to minimize butt joints and waste. Butt joints on adjoining sheets shall be staggered. Butt joints on opposite sides of the wall shall be staggered. The sheet shall be laid so that the vertical joints fall a minimum of 200mm from the edge of the opening.
- 6.10.3.11. Fire resisting systems comprising of more than one layer of plasterboards, the joints in successive layers should be staggered.



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/16

In the case of walls sheeted on both sides' joints should be staggered on opposite sides of the wall.

- 6.10.3.12. Penetrations in the system shall only be allowed if installed in accordance to manufacturer's recommendation and tested at the Contractor's expenses. Penetration shall be strictly carried out in accordance with the requirements of the DGFR and to the approval of the S.O..
- 6.10.3.13. Fasteners shall have a corrosion-resistant finish and be appropriate for intended use, also in accordance with BS EN 14566 and BS 8212, or any relevant standards. The heads of fasteners shall be shaped so that they can be driven slightly below the surface of the plasterboard without punching through the paper liner.
- 6.10.3.14. Impact resistance of a partition system including gypsum plasterboard shall be determined in accordance with ISO 7892 and BS 5234-2.
- 6.10.3.15. The Contractor shall submit to the S.O., a manufacturer's warranty against any defect or damage to the proprietary plasterboard partition system which may arise during the period of five (5) years from the date of Certificate of Practical Completion. Terms of the warranty shall be such as shall be approved by the S.O..

### 6.11. Insulation Installation

- 6.11.1. Where necessary, insulation shall be installed so that:

- 6.11.1.1. It abuts or overlaps adjoining insulation other than at supporting members such as studs, noggings, joists, furring channels and the like where the insulation must butt against the member;
- 6.11.1.2. It forms a continuous barrier with ceilings, walls, bulkheads, floors or the like that inherently contribute to the thermal barrier; and
- 6.11.1.3. It does not affect the safe or effective operation of a service or fitting.

- 6.11.2. Reflective insulation shall be installed so that:

- 6.11.2.1. The necessary airspace to achieve the required R-value between a reflective side of the reflective insulation and a building lining or cladding;
- 6.11.2.2. The reflective insulation closely fitted against any penetration, door or window opening;
- 6.11.2.3. The reflective insulation adequately supported by framing members; and
- 6.11.2.4. Each adjoining sheet of roll membrane being overlapped not less than 50mm; or taped together.



## SECTION E: WALL SYSTEM

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	00
Tarikh	:	02 Januari 2020
Muka Surat	:	E/17

6.11.3. Bulk insulation shall be installed so that:

- 6.11.3.1. It maintains its position and thickness, other than where it crosses roof battens, water pipes, electrical cabling or the like; and
- 6.11.3.2. In a ceiling, where there is no bulk insulation or reflective insulation in the wall beneath, it overlaps the wall by not less than 50mm.

6.11.4. Fixing methods of insulation material shall be as below, or as recommendation of manufacturer:

- 6.11.4.1. Use proprietary fixing methods which prevent long term sag, collapse or dislodgement; and
- 6.11.4.2. Fasteners shall be suitable non-corrosive types.

## 6.12. Glass Partitions

6.12.1. Unless otherwise specified or shown on the Drawing, all fixed glass wall systems shall be 8mm thick minimum, erected with stainless steel framing system for sizes up to 1200mm x 4800mm maximum installed to manufacturer's recommendation and to S.O.'s approval. For sizes more than 4800mm, the panels shall be constructed according to manufacturer's recommendation and the installation shall be certified by a P.E.

6.12.2. Glass doors shall be installed complete with accessories as recommended by the manufacturer and to the S.O.'s approval.



## SECTION E: WALL SYSTEM

No. Dokumen : JKR 20800-0226-20  
 No. Keluaran : 01  
 No. Pindaan : 00  
 Tarikh : 02 Januari 2020  
 Muka Surat : E/18

**TABLE E1 – MASONRY MORTARS**

	Mortar designation	Compressive strength class	Prescribed mortars (proportion of materials by volume) (see notes 1 and 2)		Compressive strength at 28 days N/mm <sup>2</sup>
			Cement (a): sand with or without air entrainment	masonry cement (b): sand	
 Increasing ability to accommodate movement, e.g. due to settlement, temperature and moisture changes	(i)	M12	-	-	12
	(ii)	M6	1 : 3 to 4	1 : 2½ to 3½	6
a. Cement, or combination of cements except masonry cements.					
i) Combinations produced in the mortar mixer from Portland cement CEM I conforming to MS EN 197 Part 1 and ground granulated blastfurnace slag conforming to MS EN 15167 Part 1 where the proportions and properties conform to CEM II/A-S or CEM II/B-S of MS EN 197 Part 1, except Clause 9 of that standard.					
ii) Combinations produced in the mortar mixer from Portland cement CEM I conforming to MS EN 197 Part 1 where the proportions and properties conform to CEM II/A-L or CEM II/A-LL of MS EN 197 Part 1, except Clause 9 of that standard.					
iii) Combinations produced in the mortar mixer from Portland cement CEM I conforming to MS EN 197 Part 1 and pulverized fuel ash conforming to MS EN 450 Part 1, where the proportions and properties conform to CEM II/A-V or CEM II/B-V of MS EN 197 Part 1, except Clause 9 of that standard.					
b. Masonry cement (inorganic filler other than lime)					
NOTE 1 Proportioning by mass will give more accurate batching than proportioning by volume, provided that the bulk densities of the materials are checked on site.					
NOTE 2 When the sand portion is given as, for example, 5 to 6, the lower figure should be used with sands containing a higher proportion of fines whilst the higher figure should be used with sands containing a lower proportion of fines.					


**SECTION E: WALL SYSTEM**

No. Dokumen : JKR 20800-0226-20  
 No. Keluaran : 01  
 No. Pindaan : 00  
 Tarikh : 02 Januari 2020  
 Muka Surat : E/19

**TABLE E2 - MINIMUM CONCRETE COVER FOR CARBON STEEL REINFORCEMENT**

Exposure situations	Concrete grade in MS EN 206 and MS 523 Part 2 & MS 523 Part 3				
	C25/30	C28/35	C32/40	C35/45	C40/50
<i>Minimum cement content (kg/m<sup>3</sup>)</i>					
	300	320	340	360	380
<b>Maximum free water/cement ratio</b>					
	0.65	0.6	0.55	0.50	0.45
<b>Thickness of concrete cover</b>					
	mm	mm	mm	mm	mm
E1 <sup>a</sup>	20	20	20 <sup>b</sup>	20 <sup>b</sup>	20 <sup>b</sup>
E2	—	35	30	25	20
E3	—	—	40	30	25
E4	—	—	—	60	50
<b>Exposure situation E1.</b> Internal work and the inner skin of ungrouted external cavity walls and behind surfaces protected by an impervious coating that can readily be inspected, or external parts built.					
<b>Exposure situation E2.</b> Buried masonry and masonry continually submerged in fresh water or external parts built.					
<b>Exposure situation E3.</b> Masonry exposed to freezing whilst wet, subjected to heavy condensation or exposed to cycles of wetting by fresh water and drying out or external parts built.					
<b>Exposure situation E4.</b> Masonry exposed to salt or moorland water, corrosive fumes, abrasion or the salt used for de-icing.					
a Alternatively, 1: 0 to ¼ : 3: 2 cement: lime : sand: 10 mm nominal aggregate mix may be used to meet exposure situation E1 when the cover to reinforcement is 15 mm minimum.					
b These covers may be reduced to 15 mm minimum provided that the nominal maximum size of aggregate does not exceed 10mm.					



## SECTION E: WALL SYSTEM

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : 02 Januari 2020  
Muka Surat : E/20

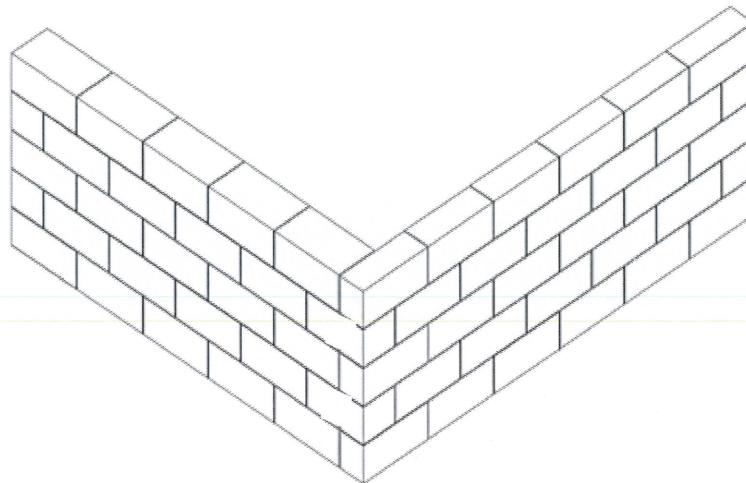


FIGURE E1: RUNNING OR STRETCHER BOND

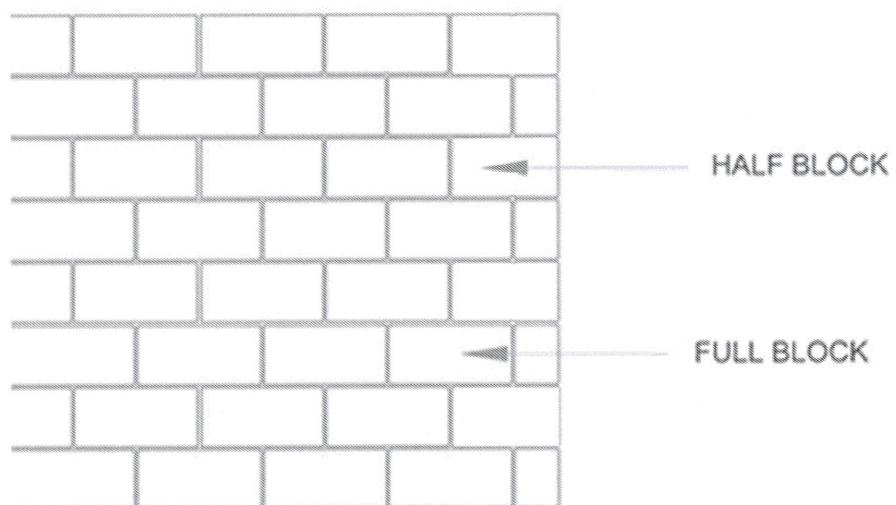


FIGURE E2: RUNNING OR STRETCHER BOND

## TABLE OF CONTENTS

<b>SECTION G: ROOFING</b>	<b>PAGE</b>
1. General	G/1
2. Interlocking Concrete Tiles	G/1
3. Clay Tiles	G/1
4. Pre-Painted Aluminium Roofing Sheet	G/2
5. Concrete Flat Roofs	G/2
6. Pre-Painted Steel Roofing Sheet	G/2
7. Roofing Sheet For Marine Environment (Coastal Areas)	G/5
8. Bituminous Corrugated Roofing Sheets	G/6
9. Bituminous Corrugated Roofing Tiles	G/6
10. Fibre-Cement Corrugated Sheets	G/7
11. Heat Insulation	G/7



## SECTION G: ROOFING

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 01  
Tarikh : 02 Januari 2020  
Muka Surat : G/1

### 1. General

- 1.1. Unless otherwise stated, the pitch and batten gauge for each type of roof covering shall be strictly in accordance with the manufacturer's recommendation.
- 1.2. Unless otherwise approved, all roof covering pieces or accessories such as eaves, hips, ridges, valley et cetera, shall be of the same material as the general covering.

### 2. Interlocking Concrete Tiles

- 2.1. Interlocking concrete roof tiles shall be laid on timber or steel battens approved for roofing at spacing and tightly nailed or screwed as recommended by the manufacturer.
- 2.2. Unless otherwise specified, the concrete roof tiles shall be laid to slope in accordance to the manufacturer's recommended pitch and to the S.O.'s approval. The roof tiles shall conform to MS797 and unless otherwise specified on the Drawings, it shall be laid on metal trusses system to engineer's detail and S.O.'s approval.
- 2.3. Water repellent materials backed with weatherproof self-adhesive compound for ridges and hips solution laid in accordance with manufacturer's instruction.
- 2.4. Verges, ridges, hips, valley tiles and complete with all roofing accessories shall be provided and laid to bond with the general roof tiling works in accordance with the manufacturer's recommendation.
- 2.5. Unless otherwise stated in the drawings, where skylight roofing sheets are to be used, they shall be of transparent skylight roofing sheets [acrylic/polycarbonate (PC)/unplasticized poly vinyl chloride (UPVC) multilayer/laminated glass] or translucent skylight roofing sheets [fibreglass reinforced polyester (FRP)] of concrete roof tiles profiles. The minimum thickness gauge and fixing system of the skylight roofing sheets is accordance with the manufacturer's recommendation.

### 3. Clay Tiles

- 3.1. Unless otherwise stated in the Drawings, clay tiles shall be of 425mm to 490mm (length) x 280mm to 300mm (horizontal width) pattern confirming to BS 402 or SS 70 and shall be free from cracks, chips and warps.
- 3.2. Clay tiles shall be laid with a minimum head lap of 75mm to 95mm on timber or steel battens approved for roofing at spacing as recommended by the tile manufacturer. The tiles shall be firmly screwed or nailed at intervals as recommended by the roofing tile manufacturer and as approved by the S.O..
- 3.3. Ridge capping, hip and valley tiles complete with all roofing accessories shall be provided to match the general tiling works in accordance with the manufacturer's recommendation. All these shall be bedded in matching water repellent materials backed with weatherproof self-adhesive compound.
- 3.4. Roofing components at roof eave to allow airflow and prevents the entry of birds and vermin into the batten cavity is recommended.
- 3.5. Unless otherwise stated in the drawings, where skylight roofing sheets are to be used, they shall be of transparent skylight roofing sheets [acrylic/polycarbonate (PC)/unplasticized poly vinyl chloride (UPVC) multilayer/laminated glass] or translucent skylight roofing sheets [fibreglass reinforced polyester (FRP)] of clay



## SECTION G: ROOFING

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 01  
Tarikh : 02 Januari 2020  
Muka Surat : G/2

roof tiles profiles. The minimum thickness gauge and fixing system of the skylight roofing sheets is accordance with the manufacturer's recommendation.

### 4. Pre-painted Aluminium Roofing Sheet

- 4.1. Unless otherwise stated, where aluminium roofing sheets are to be used, they shall be of the type, gauge and finish as shown in the Drawings and to be fixed strictly in accordance with the manufacturer's recommendation.
- 4.2. Unless otherwise stated in the drawings, where skylight roofing sheets are to be used, they shall be of transparent skylight roofing sheets [acrylic/polycarbonate (PC)/unplasticized poly vinyl chloride (UPVC) multilayer/laminated glass] or translucent skylight roofing sheets [fibreglass reinforced polyester (FRP)] of aluminium roof sheets profiles. The minimum thickness gauge and fixing system of the skylight roofing sheets is accordance with the manufacturer's recommendation.

### 5. Concrete Flat Roofs

Concrete flat roofs shall be as specified under SECTION D: CONCRETING.

### 6. Pre-painted Steel Roofing Sheet

- 6.1. Unless otherwise stated, the metal roof decks shall comply with the following:

#### 6.1.1. Materials

- 6.1.1.1. The roofing sheets shall be produced from zinc coated steel conforming to MS2385 and AS 1397: "Hot-Dip Zinc-Coated Carbon Steel Sheet of Commercial and Drawing Qualities", MS 2384: "Hot-Dip Zinc-Coated Carbon Steel Sheet of Structural Quality" and JIS G3302: "Hot-Dip Zinc-Coated Steel Sheet and Strip" OR be produced from aluminium/zinc alloy coated steel conforming to MS 1196: "Continous Hot-Dip Aluminium/Zinc Coated Steel Sheet of Commercial, Drawing and Structural Qualities" and AS 1397 "Steel Sheet and Strip: Hot-Dip Zinc Coated or Aluminium/Zinc Coated".
- 6.1.1.2. The pre-painted finish over the zinc coated base steel OR aluminium/zinc alloy coated base steel shall conform to MS 2383: "Prefinished/Pre-painted Sheet Metal Products for Interior/Exterior Building Applications – Performance Requirements" under product type 3 conforming to ISO 9223 Category 3 (C3) environment. and AS/NZS 2728: "Prefinished/Pre-painted Sheet Metal Products for Interior/Exterior Building Applications – Performance Requirements".
- 6.1.1.3. The exterior finish coat shall have a nominal film thickness of 20µm over 5µm thick corrosion inhibitive primer on top side or weather side. The backing coat shall be with nominal film thickness of 5µm over 5 µm corrosion inhibitive primer.
- 6.1.1.4. Minimum steel yield strength shall be 300 or 550MPa.



## SECTION G: ROOFING

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 01  
Tarikh : 02 Januari 2020  
Muka Surat : G/3

- 6.1.1.5. The minimum aluminium/zinc alloy coating mass shall be 150g/m<sup>2</sup> (Coating Class AZ 150) on both surfaces conforming to ISO 9223 Category 3 (C3) environment.
- 6.1.1.6. The Contractor shall submit material warranty from the manufacturer in accordance with ISO 9223: "Corrosion of Metals and Alloys – Corrosivity of Atmosphere - Classification" of the project site and the format approved by the S.O. Material warranty shall be up to 25 years against perforation by corrosion, 15 years against flake and peel, 10 years against colour fading and 5 years against dirt staining.
- 6.1.1.7. The Contractor shall submit shop drawings for the S.O.'s approval prior to commencement of installation works.
- 6.1.1.8. Unless otherwise stated in the drawings, where skylight roofing sheets are to be used, they shall be of transparent skylight roofing sheets [acrylic/polycarbonate (PC)/unplasticized poly vinyl chloride (UPVC) multilayer/laminated glass] or translucent skylight roofing sheets [fibreglass reinforced polyester (FRP)] of steel roof sheets profiles. The minimum thickness gauge and fixing system of the skylight roofing sheets is accordance with the manufacturer's recommendation.

### 6.1.2. Metal Sheet Profiles

- 6.1.2.1. Unless otherwise specified or shown in the Drawings, the metal sheet profile shall be of a concealed fixing system complying with MS2500 as approved by the S.O.. The roofing sheets shall have the following-requirements:
- (i) Base Metal Thickness (BMT) = 0.42mm.
  - (ii) Total Coating Thickness (TCT)= 0.47mm
  - (iii) Cover width = 430mm to 680 mm.
  - (iv) Rib height = 25mm to 43 mm.
  - (v) Coating = Pre-painted aluminium/zinc coated steel with AZ150 (150g/m<sup>2</sup>) or AZ200 (200g m<sup>2</sup>) on both surfaces.
- 6.1.2.2. Where pierced fixing system complying with MS 2500 is specified or shown in the Drawings, the roofing sheet shall have the following requirements:
- (i) Base Metal Thickness (BMT) = 0.42mm.
  - (ii) Total Coating Thickness (TCT) = 0.47mm
  - (iii) Cover width = 750 to 1015mm
  - (iv) Rib height = 16mm to 38mm
  - (v) Coating = Pre-painted aluminium/zinc coated steel with AZ150 (150g/m<sup>2</sup>) or AZ200 (200g m<sup>2</sup>) on both surfaces.

 <b>JKR MALAYSIA</b>	<b>SECTION G: ROOFING</b>	No. Dokumen : JKR 20800-0226-20 No. Keluaran : 01 No. Pindaan : 01 Tarikh : 02 Januari 2020 Muka Surat : G/4
--	---------------------------	--

**6.1.3. Fixing**

6.1.3.1. Installation procedures shall conform to the recommendation of the manufacturer.

6.1.3.2. The roofing sheets shall be installed and fixed according to the following method:

- (i) Concealed fixing using approved clips compatible with the roofing sheet.
- (ii) Pierced fixing using approved fasteners compatible with the roofing sheet.

6.1.3.3. The roofing installer shall be registered with CIDB.

6.1.3.4. Metallic swarf and all other debris including nail, screws, mortar, construction materials et cetera shall be swept away from the roof area and gutters regularly, particularly at the end of each day's work and at completion of the installation works.

**6.1.4. Clips and Fasteners**

6.1.4.1. Fasteners type shall comply with AS 3566 Class 3 and be certified as such by the supplier of fasteners.

6.1.4.2. The recommended type of fasteners shall conform to the following test:

- (i) Salt spray test - 1000 hours
- (ii) Kesternich test - 15 cycles.
- (iii) Humidity test - 1000 hours.
- (iv) UV test - 2000 hours.

6.1.4.3. All fasteners and screws shall be of the self-drilling type either concealed or screwed fixing, complete with preassembled ethylene propylene diene monomer (EPDM) rubber washers.

**6.1.5. Flashing and Capping**

Approved 0.42mm BMT ridge capping, flashing, capping and trimming shall be manufactured to the required shape and sizes. The flashing and capping materials used shall be from the same material as the roofing sheets.

**6.1.6. Sealants**

Only neutral cure silicone rubber sealant type Dow Corning 780 or equivalent shall be used conforming to AS 3902.

**6.1.7. Lightning Conductors**

Aluminum lightning conductor is recommended for use on steel roof system.



## SECTION G: ROOFING

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 01  
Tarikh : 02 Januari 2020  
Muka Surat : G/5

- 6.2. All fixing accessories shall be rust-resistant and of suitable design and construction as recommended by the manufacturer for the roofing system and as approved by the S.O.. All fasteners and screws shall be of the self-drilling type either concealed or screwed fixing, complete with preassembled EPDM rubber washers.
- 6.3. Identification, storage and packaging of alum/zinc steel roof decking shall be strictly in accordance with the manufacturer's recommendation and comply with the S.O.'s requirements.
- 6.4. All roof decking sheets, capping, flashing et cetera or wall cladding shall be new, clean, regular, straight and true to shape with sharp defined profiles, free from cracks, chips, bends and defects detrimental to practical use or from other surface imperfections.
- 6.5. At Site, the sheets shall be lifted from the transport carrier by a crane and properly stacked clear of the ground, ready to be lifted up to the roof structure for laying. Where sheets are to be manually lifted, care should be taken not drag the sheets to avoid scraping away the surface coating.
- 6.6. Where storage is necessary, stack heights shall be kept to a minimum and the sheets shall be stacked in a sloping position. Sheets shall be stacked off a dry firm ground, under cover by tarpaulin or polythene sheets but ventilated and away from building operations. Should the stack sheets become wet, they shall be immediately dried to prevent staining and degradation of the surface coatings.
- 6.7. The Contractor shall be responsible for the absolute water-tightness of the roof and must ensure that the method of installation, fixing and fastening decking sheets, caps, flashings et cetera including acoustical, insulation and expansion joints, whenever required shall conform strictly to the manufacturer's recommendation.
- 6.8. The completed portions of the roof shall be clear of all metallic particles such as blind rivet shanks, screws, nuts, nails et cetera and dirty foot prints should be wiped off to avoid early deterioration/corrosion and discolouration. Damages to the coating shall be repaired with touch-up paint as recommended by the manufacturer and approved by the S.O..

## 7. Roofing Sheet for Marine Environment (Coastal Areas)

- 7.1. The Contractor shall select the correct type of metal sheet profile to be installed for coastal areas as recommended by the roof manufacturer and approved by the S.O..
- 7.2. Unless otherwise specified or shown in the Drawings, the roofing sheet for marine environment shall be metallic coated steel with minimum zinc coating mass of 350g/m<sup>2</sup> (Coating Class Z350) OR minimum aluminium/zinc alloy coating mass of 200g/m<sup>2</sup> (Coating Class AZ 200) on both surfaces.conforming to ISO 9223 Category 4 (C4) and Category 5 (C5) environment.
- 7.3. Metallic coated steel with zinc or aluminium/zinc alloy shall be manufactured and certified by SIRIM according to MS2385:"Hot-Dip Zinc-Coated Carbon Steel Sheet of Commercial and Drawing Qualities" or MS 2384:"Hot-Dip Zinc-Coated Carbon Steel Sheet of Structural Quality" OR MS 1196 'Continuous Hot-Dip Aluminium/Zinc Coated Steel Sheet of Commercial, Drawing and Structural Qualities' or AS 1397 'Steel Sheet and Strip: Hot-Dip Zinc Coated or Aluminium/Zinc Coated'.
- 7.4. The pre-painted finish (super polyester paint or PVDF paint) type shall be used over the zinc coated base OR aluminium/zinc alloy coated base steel shall conform to MS 2383: "Prefinished/Pre-painted Sheet Metal Products for Interior/Exterior

 <b>JKR MALAYSIA</b>	<b>SECTION G: ROOFING</b>	No. Dokumen : JKR 20800-0226-20 No. Keluaran : 01 No. Pindaan : 01 Tarikh : 02 Januari 2020 Muka Surat : G/6
--	---------------------------	--

Building Applications - Performance Requirements" and AS/NZS 2728: "Prefinished/Pre-painted Sheet Metal Products for Interior/Exterior Building Applications - Performance Requirements" under product type 5 and 6 conforming to ISO 9223 Category 5 (C-5) environment.

- 7.5. Fasteners used shall comply with AS 3566 Class 4 and be certified as such by the supplier of fasteners and to the approval of the S.O..
- 7.6. All fixings and associated components shall be manufactured from compatible metals and coated conforming to ISO 9223 Category 4 (C4) and Category 5 (C5) environment. Flashings shall be made from the same material as the roofing sheets.
- 7.7. Unless otherwise stated in the drawings, where skylight roofing sheets are to be used, they shall be of transparent skylight roofing sheets [acrylic/polycarbonate (PC)/unplasticized poly vinyl chloride (UPVC) multilayer/laminated glass] or translucent skylight roofing sheets [fibreglass reinforced polyester (FRP)] of roof sheets profiles. The minimum thickness gauge and fixing system of the skylight roofing sheets is accordance with the manufacturer's recommendation.

## 8. Bituminous Corrugated Roofing Sheets

- 8.1. Unless otherwise shown on the Drawing, the bituminous corrugated roofing sheets shall have the following minimum requirements:
  - 8.1.1. Length = 2000mm
  - 8.1.2. width = 950mm
  - 8.1.3. cover width = 855mm
  - 8.1.4. thickness = 3mm
  - 8.1.5. weight of material = 3.3kg/m<sup>2</sup>
  - 8.1.6. thermal resistance R- value = 0.04mK/W
  - 8.1.7. thermal conductivity = 0.066W/mk
- 8.2. Unless otherwise shown on the Drawings, the Bituminous Corrugated Roofing Sheets shall be laid at a minimum roof pitch of 5° on timber battens at spacing and tightly nailed/screwed as recommended by the manufacturer.
- 8.3. Ridge capping, nails and screws shall be provided to match the roofing sheets while ridges, verges, eaves, hips, valleys, side-wall and end-wall details shall be fixed strictly in accordance with the manufacturer's recommendation.

## 9. Bituminous Corrugated Roofing Tiles

- 9.1. Unless otherwise shown on the Drawing, the bituminous corrugated roofing tiles shall have the following minimum requirements:
  - 9.1.1. Length = 1060mm
  - 9.1.2. Width = 400mm
  - 9.1.3. Wave Height = 40mm

 <b>JKR MALAYSIA</b>	<b>SECTION G: ROOFING</b>	No. Dokumen : JKR 20800-0226-20 No. Keluaran : 01 No. Pindaan : 01 Tarikh : 02 Januari 2020 Muka Surat : G/7
--	---------------------------	--

- 9.1.4. thickness = 3mm
- 9.2. Bituminous roofing tiles shall be laid at a minimum roof pitch of 9° and on timber or steel battens approved for roofing at spacing and tightly nailed/screwed as recommended by the manufacturer.
- 9.3. Ridge capping, nails and screws shall be provided to match the roofing tiles while ridges, verges, eaves, hips, valleys, side-wall and end-wall details shall be fixed strictly in accordance with the manufacturer's recommendations.

#### 10. Fibre-cement Corrugated Sheets

- 10.1. Fibre-cement corrugated sheets shall comply with MS 1224. The thickness of the sheets shall be 3mm thick for shallow corrugation and 4mm thick for medium corrugation. The cement shall comply with MS 522: Part 1. Asbestos processed or unprocessed shall not be added to fibre-cement sheets.
- 10.2. The surface intended to be exposed to the weather shall have a generally smooth finish. Variations of the surface appearance which do not impair the characteristics of the sheets as defined in MS 1224 are permitted.
- 10.3. Unless otherwise stated in the drawings, where skylight roofing sheets are to be used, they shall be of transparent skylight roofing sheets [acrylic/polycarbonate (PC)/unplasticized poly vinyl chloride (UPVC) multilayer/laminated glass] or translucent skylight roofing sheets [fibreglass reinforced polyester (FRP)] of corrugated roof tiles profiles. The minimum thickness gauge and fixing system of the skylight roofing sheets is accordance with the manufacturer's recommendation.

#### 11. Heat Insulation

##### 11.1. General

Heat insulation system shall comply with MS 1020 and MS 1525. Samples of the insulation material shall be submitted to the S.O. for approval before they are used, and subsequent delivery shall be up to the standard of samples approved.

##### 11.2. Reflective Foil

- 11.2.1. Reflective foil shall be fire retardant double sided aluminium reflective foil bonded to reinforced high density polyethylene woven fabric comply with MS2095 : 2014

- 11.2.2. The reflective foil materials used shall conform to fire safety requirements and BS 476 Part 6 & Part 7 (Class O): Fire Test on Building Materials and Structures on the following test:

- 11.2.2.1. Part 6: Method of test for fire propagation for products conforming to BS 476

- 11.2.2.2. Part 7: Method of test to determine the classification of the surface spread of flame confirming to BS 476

- 11.2.3. Reflective foil properties shall conform to the following:

- 11.2.3.1. Thickness : 137 ± 20 micron thick.

- 11.2.3.2. Grammage : 163 ± 10g/m<sup>2</sup>.



## SECTION G: ROOFING

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 01  
Tarikh : 02 Januari 2020  
Muka Surat : G/8

11.2.3.3. Tensile strength : 500 N/ 50mm (MD), 500 N/50mm (Cross Direction) MD≥9.5 ; CD≥6.0.

11.2.3.4. Emissivity ASTM E408 ≤ 0.05(97±2%) / Reflectivity = 95%  
ASTM C1371 ≤0.05

11.2.3.5. Initial Tear resistance: ASTM D1004 >30N ≥65.0

11.2.4. Reflective foil material may be used on its own with all types of roofs except with metal decking roof. Where roof is of metal decking, the reflective insulation material shall be laid below stone wool or glass wool for effective thermal and acoustic performance.

11.2.5. The reflective foil material shall be installed strictly in accordance with the manufacturer's recommendation. A uniform air space of 20mm to 50mm between the tile roof covering and the insulation material shall be provided to ensure the effectiveness of the reflective surface. All punctures shall be effectively sealed with similar reflective material to prevent air leakage and moisture transfer.

11.2.6. The reflective foil surface shall be free from any thin film of oil, plastic or lacquer coatings. All dust and/or moisture, if any, shall be thoroughly cleaned prior to installation. All dust and/or trademarks shall be limited to a maximum of 5% of the total reflective area. The insulation material shall be fitted closely around electrical outlet boxes, plumbing and et cetera, and taped securely to eliminate gaps or voids through which air or water vapour might pass into the cooler space.

### 11.3. Glass Wool Insulation

11.3.1. Unless otherwise shown in the Drawings, It shall have R-Value @ R2.0 to R2.3 m<sup>2</sup>KW (tested at a mean temperature of 20°C based MS1020 and MS1525 tested according to ASTM C177/C518). The glass wool insulation material used shall conform to BS 476 for Fire tests on building materials and structures on the following:

11.3.1.1. Part 6: Method of test for fire propagation for products conforming to BS 476

11.3.1.2. Part 7: Method of test to determine the classification of the surface spread of flame confirming to BS 476

11.3.2. The glass wool insulation material used shall be of no added urea formaldehyde and as approved by the S.O.. Glass wool insulation shall be fixed in accordance with the manufacturer's recommendations and to the approval of the S.O..

11.3.3. Where single skin metal roof is applied, galvanized wire mesh BRC 3316 or equivalent shall be used to support the reflective foil and the glass wool insulation.

### 11.4. Mineral Wool Insulation

11.4.1. Unless otherwise shown in the Drawings, it shall have R-Value @ R2.0 to R2.3 m<sup>2</sup>KW (tested at a mean temperature of 20°C based MS1020 and MS1525 tested according to ASTM C177/C518). The mineral wool insulation material used shall conform to BS 476 for Fire tests on building materials and structures on the following:

 <b>JKR MALAYSIA</b>	<b>SECTION G: ROOFING</b>	No. Dokumen : JKR 20800-0226-20 No. Keluaran : 01 No. Pindaan : 01 Tarikh : 02 Januari 2020 Muka Surat : G/9
--	---------------------------	--

- 11.4.1.1. Part 6: Method of test for fire propagation for products conforming to BS 476.
- 11.4.1.2. Part 7: Method of test to determine the classification of the surface spread of flame confirming to BS 476.
- 11.4.2. The mineral wool insulation material used shall be of no added urea formaldehyde and as approved by the S.O.. Mineral wool insulation shall be fixed in accordance with the manufacturer's recommendations and to the approval of the S.O..
- 11.4.3. Where single skin metal roof is applied, galvanized wire mesh BRC 3316 or equivalent shall be used to support the reflective foil and the mineral wool insulation.

#### 11.5. Stone Wool Insulation

- 11.5.1. Unless otherwise shown in the Drawings, stone wool insulation shall be 50mm thick minimum. It shall have R-Value @ R2.0 m<sup>2</sup>·KW (tested at a mean temperature of 20°C based MS1020 and MS1525 tested according to ASTM C177/C518). The stone wool insulation material used shall conform to BS 476 for Fire tests on building materials and structures on the following:
  - 11.5.1.1. Part 6: Method of test for fire propagation for products conforming to BS 476.
  - 11.5.1.2. Part 7: Method of test to determine the classification of the surface spread of flame confirming to BS 476.
- 11.5.2. The stone wool insulation shall conform to the following:
  - 11.5.2.1. Thermal conductivity 0.034 - 0.036 W/mK at 20°C mean temperature tested in accordance to ASTM C518.
  - 11.5.2.2. Noise reduction coefficients (NRC) of up to 1.0 tested to BS EN ISO354 at 50mm thickness.
  - 11.5.2.3. Non-combustible according to BS 476 Part 4 or EN 13501-1 and melting point of at least 1000°C in accordance to ASTM E794.
  - 11.5.2.4. No CFCs, HFCs, HCFCs or asbestos shall be used in the manufacture of the product.
  - 11.5.2.5. No perceptible odor shall be present when tested in accordance to ASTM C665.
  - 11.5.2.6. Not sustaining fungus growth under normal conditions according to ASTM C1338.
  - 11.5.2.7. The metal plates (steel and aluminium) in contact with the insulation shall show no corrosion greater than that observed on the comparative plates in contact with sterile cotton according to ASTM C665.
  - 11.5.2.8. Flame spread index less than zero (0) and smoke developed index less than five (5) according to ASTM E84.



## SECTION G: ROOFING

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 01  
Tarikh : 02 Januari 2020  
Muka Surat : G/10

- 11.5.2.9. Total VOC emission shall be less than 0.25 mg/m<sup>3</sup> and particles emission shall be less than 0.02 mg/m<sup>3</sup> tested according to ASTM D5116.
  - 11.5.2.10. Moisture absorption shall be less than or equal to 0.04%vol. according to ASTM C1104/C1104M and water absorption shall be less than or equal to 0.5kg/m<sup>2</sup> (short-term immersion) according to EN1609.
  - 11.5.3. The stone wool insulation material used shall be of no added urea formaldehyde and as approved by the S.O.. Stone wool insulation shall be fixed in accordance with the manufacturer's recommendation and to the approval of the S.O..
  - 11.5.4. The insulation material must be protected from the exposure of rain, water immersion and chemical contamination during the storage and installation. If the insulation is in contact with water, adequate drying time must be allowed to ensure that the insulation is completely dried prior to covering of the roof covers.
  - 11.5.5. The stone wool insulation shall be installed to the thickness specified and place butt jointed. Wherever possible the Contractor shall avoid the compression of the insulation material.
  - 11.5.6. Where single skin metal roof is applied, galvanized wire mesh BRC 3316 or equivalent shall be used to support the reflective foil and the stone wool insulation.
- 11.6. Cellulose Insulation
- 11.6.1. Unless otherwise shown in the Drawings, spray applied cellulose insulation shall be 30mm thick minimum. It shall have K-Value of 0.029 W/mK based MS1020 and MS1525 tested according to ASTM C177. The spray applied cellulose insulation material used shall conform to BS 476 Part 6 &7 for Fire tests on building materials and structures on the following:
    - 11.6.1.1. Method of test for fire propagation for products.
    - 11.6.1.2. Method of test to determine the classification of the surface spread of flame.
  - 11.6.2. Cellulose insulation shall be:
    - 11.6.2.1. Thickness = 30mm
    - 11.6.2.2. Thermal conductivity (k-value) = 0.0029 W/mK tested to ASTM C-177.
    - 11.6.2.3. Fire retardant Class "O" complying with BS476 Part 6 & 7 and endorsed by Jabatan Bomba Dan Penyelamat Malaysia.
    - 11.6.2.4. Average moisture absorption of not more than 15% as per ASTM C739.
    - 11.6.2.5. Tested Noise Reduction Coefficient of NRC 0.75 at 30mm thickness.

**SECTION G: ROOFING**

No. Dokumen	:	JKR 20800-0226-20
No. Keluaran	:	01
No. Pindaan	:	01
Tarikh	:	02 Januari 2020
Muka Surat	:	G/11

11.6.2.6. Tested to be non-toxic and asbestos free, contain no carcinogenic materials and shall not cause any skin irritation to humans

## TABLE OF CONTENTS

<b>SECTION J: STRUCTURAL STEEL AND METAL WORKS</b>	<b>PAGE</b>
1. General	J/1
2. Hot Rolled Structural Steelworks	J/1
3. Prefabricated Cold Formed Steel Roof Trusses	J/2
4. Metal Frames for Doors and Windows	J/4
5. Collapsible Gates, Roller Shutters And Et Cetera	J/6
6. Sundries	J/6



## SECTION J: STRUCTURAL STEEL AND METALWORKS

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : : 02 Januari 2020  
Muka Surat : J/1

### 1. General

This section provides the generally applicable requirements for steel and metal for the construction of structures, building components and related works. All materials shall conform to the relevant Malaysian or British or European Standards.

### 2. Hot Rolled Structural Steelworks

2.1. All hot rolled structural steelworks design, materials, drawings, workmanship, protective treatment, fire protection, Quality Assurance and Quality Control shall be in accordance with the *Specification for Structural Steelworks No. JKR 20601-0191-12*.

2.2. Quality Assurance and Quality Control (QA & QC)

The Contractor shall submit a Quality Assurance and Quality Control programme as specified in the Specification for Structural Steelworks as in sub-section 2.1..

2.3. Drawings and Design Calculations

2.3.1. The Drawings to be submitted by the Contractor based on construction drawings are as follows:

- 2.3.1.1. Fabrication drawings;
  - Shop drawings;
  - Erection drawings;

2.3.1.2. As-built drawings.

2.3.2. In the event that the Contractor is required to provide the design, he shall prepare Drawings with details in accordance with MS EN 1993 or other relevant standards. The Drawings and design calculations shall be certified by a Professional Engineer. He shall also prepare Drawings and arrangements of temporary steelworks for the different stages of construction in compliance with the requirements specified in the *Specification for Structural Steelworks* as in sub-section 2.1..

2.4. Records

2.4.1. The Contractor shall submit to the S.O., document and records which shall include but not limited to:

2.4.1.1. Drawings as in sub-section 2.3. and documentation register;

2.4.1.2. Mill certificates for materials and certification for consumables;

2.4.1.3. Calibration of equipment;

2.4.1.4. Weld procedures, concessions et cetera;

2.4.1.5. Inspection and laboratory test reports;

2.4.1.6. Delivery schedules and method statements for fabrication and installation;

2.4.1.7. Surveys and final inspection results.

2.4.1.8. Completion of erection and hand over certification.

 <b>JKR MALAYSIA</b>	<b>SECTION J: STRUCTURAL STEEL AND METALWORKS</b>	No. Dokumen : JKR 20800-0226-20 No. Keluaran : 01 No. Pindaan : 00 Tarikh : : 02 Januari 2020 Muka Surat : J/2
--	---	--

## 2.5. Installation of Long Span Steel Trusses

The S.O. shall ensure that the installation of long span trusses more than 20m clear span is in accordance to the checklist of requirement and condition in **Appendix J/1**.

## 3. Prefabricated Cold Formed Steel Roof Trusses

3.1. All prefabricated components shall be manufactured only by reputable licensed truss suppliers listed in *J-TRUSS system online (Application and Approval of Truss System Provider)* and approved by the S.O.. This supplier duly termed as 'System Provider' is responsible for the analysis, design, detailing, drawing, manufacture, material, handling and erection of the roof members, and their ancillary fixing components. The full requirement is outlined in the *Specification for Prefabricated Cold Formed Steel Roof Trusses (JKR 20601-0186-11)*.

### 3.2. System Provider

The System Provider (S.P) is a supplier of a proprietary roof truss system appointed by the Contractor and approved by the S.O, which employs Quality Assurance procedures in the design, detailing, connection, bracing, erection criteria and manufacture of truss components for the structural roof truss system.

### 3.3. Duties of Professional Engineer

- 3.3.1. The S.P. shall appoint a Professional Engineer (P.E.) whose duties shall include the followings:
- 3.3.1.1. Preparation of roof truss analysis and design;
  - 3.3.1.2. Preparation of drawings;
  - 3.3.1.3. Design changes in every stage of work;
  - 3.3.1.4. Certification for completion of roof truss installation;
  - 3.3.1.5. Final certification for roof truss installation prior to issuance of Certificate of Practical Completion for the whole Works to the Contractor.

### 3.4. Fabricator

All trusses shall only be assembled by licensed fabricators approved by the S.P. and registered with CIDB. A copy of CIDB registration certificate shall be submitted to the S.O. for verification.

### 3.5. Installer

All installation works shall be executed and supervised by qualified personnel with valid certificate issued by CIDB. The S.O. shall verify the identification and qualification of the installer prior to the installation.

### 3.6. General Truss Limitation

- 3.6.1. Prior to any prefabricated cold formed roof trusses works, the following general limitation shall be applied:



## SECTION J: STRUCTURAL STEEL AND METALWORKS

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : 02 Januari 2020  
Muka Surat : J/3

- 3.6.1.1. Maximum unsupported truss span 13 m with permitted deviation of  $\pm 0.05\text{m}$ .
- 3.6.1.2. Maximum truss spacing of 1.2m with permitted deviation of  $\pm 0.025 \text{ m}$ .
- 3.6.1.3. The minimum basic wind speed shall be 35m/s. However, the minimum basic wind speed shall be increased to 41m/s for lightweight roof covering.
- 3.6.1.4. Minimum base steel thickness for main truss member shall be:
  - a) 1mm for unsymmetrical section or open cross section;
  - b) 0.6mm for symmetrical machine-manufactured box or closed cross section.
- 3.6.1.5. Minimum base steel thickness for other truss element shall be:
  - a) 0.5mm for batten or purlin;
  - b) 1.2mm for wall plate;
  - c) 1mm for all bracings.

### 3.7. Analysis, Design Report and Drawings Submission

- 3.7.1. The S.P. through the Contractor shall propose to the S.O. for his approval a roof truss system which is safe, functional and conforming to design standard. Submission of proposal shall include truss analysis, design report, and construction drawings. The truss analysis shall indicate all loads, load combinations, connections criteria, bracings and tie-down of the truss. Design output of the truss members, battens, connections, tie-down and wall plates, anchors, bracings, truss accessories, splicing and stiffeners where related to the analysis shall be included in the design report. Refer to **Appendix 3** of JKR 20601-0186-11.
- 3.7.2. All details in the construction drawings shall be sufficient to enable checking against the analysis and design report, including specifying and providing the truss layout and configuration, steel grades, section properties of members, length of members in each truss configuration, properties of truss accessories, specification of corrosion protection, specification of fastener and anchor, tie-down and anchoring details and all types of connection details including the connection of all attachments to the trusses.
- 3.7.3. Technical specifications or mill certificates for base steel, fastener and anchor shall also be included in the submission. Verification test certificate from an approved accredited laboratory on the technical parameter specified in the technical specifications or mill certificates shall be submitted upon request by the S.O..

### 3.8. Warranty

- 3.8.1. When a prefabricated cold formed steel roof truss system is used, the Contractor shall submit to the S.O. a warranty from the S.P. with the following provisions:
  - 3.8.1.1. The products used are genuine and free from manufacturing defects;

**SECTION J: STRUCTURAL STEEL  
AND METALWORKS**

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : : 02 Januari 2020  
Muka Surat : J/4

- 3.8.1.2. The prefabricated cold formed steel roof truss system is installed in accordance with the S.P.'s instructions, guidance and specifications that will deliver the specified level of performance;
- 3.8.1.3. The warranty certificate shall cover a period of ten (10) years from the date of Certificate of Practical Completion against any defect or failure due to the installation and workmanship by the S.P.'s registered panel installer.

**4. Metal Frames for Doors and Windows****4.1. Steel Frames**

- 4.1.1. The Contractor shall supply, assemble and fix steel frames for doors and windows as shown on the Drawings. The steel frames shall comply with *BS 6510*, and shall be from an approved source and shop-primed with two coats of red lead oxide or other approved rust resisting primer.
- 4.1.2. The steel frames shall be manufactured from sections rolled from good commercial grade galvanized mild steel in single sections, mechanically straightened with all corners pre-cut with a 45 degrees mitre joint giving a snug and accurate fit, fully electrically welded, and carefully ground and cleaned, or shall be mechanically jointed by an approved method.
- 4.1.3. All screws, nuts, bolts and washers shall be of stainless steel.
- 4.1.4. Steel frames shall be painted as specified in SECTION O: PAINTING.

**4.2. Aluminium Frames**

- 4.2.1. The Contractor shall supply, assemble and fix aluminium frames for doors and windows as shown on the Drawings. Unless otherwise specified, all aluminium frames for windows shall be fabricated from sections extruded from aluminium alloy conforming to *MS 832*. All aluminium frames for glass sliding doors shall be fabricated from sections extruded from aluminium alloy and in compliance with *MS 1017*.
- 4.2.2. Unless otherwise shown on the Drawings or described in the Bills of Quantities, aluminium surfaces shall be natural anodised finish, free from alloy defects, dye marks, scratches and other surface blemishes in accordance with *BS 3987* with an anodic coating of  $15\mu$  minimum thickness complying with *BS EN 12373-1*.
- 4.2.3. All coloured anodized finish to aluminium exposed surfaces shall be subject to the S.O.'s approval.
- 4.2.4. All aluminium extrusion or sheet exposed surfaces after anodizing and after colouring, if required by the S.O., shall be sealed, and the adequacy of the sealing shall be given special emphasis.
- 4.2.5. All fasteners such as bolts and screws shall be of stainless steel type A2-70 (minimum) in compliance with *ISO 3506* or other suitable materials as specified in the Drawings. Rivets shall be stainless steel or aluminium alloy appropriate to the applications.



## SECTION J: STRUCTURAL STEEL AND METALWORKS

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : 02 Januari 2020  
Muka Surat : J/5

4.2.6. Extruded aluminium framing members shall be fabricated from designated alloys complying with MS 2289. Ancillary members such as sills, couplings and the like formed from sheet materials, they shall be fabricated from designated alloys complying with MS 2040.

4.2.7. Where friction stays and hinges are fastened onto the framing section, the portion that receives the fastener shall not be less than 2.5mm thick.

### 4.3. Frames for Adjustable Louvre Windows

4.3.1. The Contractor shall supply, assemble and fix frames for adjustable louvre windows as shown on the Drawings in compliance with MS 1057.

4.3.2. Unless otherwise specified, the frames shall be of approved manufacture. The frames shall be supplied complete with weather seal and non-ferrous bearings, spring clips, locking device and weather stripping with all necessary spacing pieces. The frames, coupling mullions and spacer brackets shall be minimum 1.2mm thick (18 SWG) or otherwise specified cold-rolled steel strip galvanised with hot-dipped process. Unless otherwise specified on the Drawings, the clips and pivots to receive the louvres shall be of durable nylon material and sample submitted shall be to S.O.'s approval.

4.3.3. The operating rods shall be 2.13mm thick (14 SWG). The handle and lock shall be 2.642mm thick (12 SWG) steel.

4.3.4. Unless otherwise specified, the finish shall be anodized coating of 15  $\mu$  (average) minimum complying with BS EN 12373-1.

### 4.4. Accessories

4.4.1. Accessories for each steel or aluminium frame for doors and windows shall be supplied complete with:

4.4.1.1. Sufficient number of built-in stainless steel hinges as per Schedule of Ironmongery under SECTION H: TIMBER, JOINERY AND IRONMONGERY;

4.4.1.2. Two (2) rubber buffers per closing jamb, to reduce noise and vibration;

4.4.1.3. Welded mortar guard; Adjustable stainless steel striker plate with a gently curved lead-in edge; Removable spreader bars, to ensure a perfect square during transportation and installation; and

4.4.1.4. Minimum of eight (8) pieces of 4mm brick ties, to ensure a tight permanent fit.

### 4.5. Samples

Samples of steel or aluminium sections with complete accessories for the doors and windows, together with complete set of shop drawings of all works shall be submitted to the S.O.'s for approval prior to the commencement of any work.



## SECTION J: STRUCTURAL STEEL AND METALWORKS

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : 02 Januari 2020  
Muka Surat : J/6

### 4.6. Installation

- 4.6.1. Unless otherwise specified or shown on the Drawings, all types of window and door frames shall be fixed or installed using the sub-frame method in accordance with the manufacturer's recommendation and to the S.O.'s approval.
- 4.6.2. All joints on the window and door frames shall be sealed using polyurethane (PU) type joint sealant.
- 4.6.3. Where buildings are located near to the coastal area, the bolts, nuts and screws used shall be of stainless steel unless otherwise specified.
- 4.6.4. Unless otherwise specified in the Drawings, the adjustable louvre side frames shall fix to the aluminium frames and shall be installed using the sub-frame method in accordance with the manufacturer's recommendation and to the S.O.'s approval.

### 5. Collapsible Gates, Roller Shutters and Et Cetera

The Contractor shall provide and fix approved collapsible steel gates, folding shutters, roller shutters and et cetera complete with all necessary accessories as approved by the S.O. to the sizes and positions as shown on the Drawings. Unless otherwise specified in the Drawings, they shall be galvanised and fixed in accordance with the manufacturer's instructions.

### 6. Sundries

- 6.1. Unless otherwise specified in the Drawings, mild steel shall be used for balustrades to staircases, verandahs, balconies, et cetera and shall be fixed as shown on the Drawings.
- 6.2. All iron and steel for the sundries shall be of the quality approved by the S.O.. Screws and bolts shall have washers where appropriate. Hooks for carrying ceiling fans shall be formed from 13mm diameter mild steel rods bolted to timber ceiling members or ragged into concrete.
- 6.3. Welded mesh, expanded metal, aluminium sheets et cetera shall be provided and fixed as shown on the Drawings.
- 6.4. Mild steel grilles, drain cover gratings shall be provided and fixed as shown on the Drawings. Unless otherwise stated, all steelworks shall be joined by continuous welding.
- 6.5. Ant caps shall be of 16 gauge galvanised iron sheets formed to shape as shown on the Drawing. The caps shall be fixed between concrete stumps/brick piers or walls and timber posts or plates as required. The caps shall project 60mm and inclined at 45° from the surface.

**SECTION J: STRUCTURAL STEEL  
AND METALWORKS**

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : : 02 Januari 2020  
Muka Surat : J/7

**APPENDIX J/1**

**CHECKLIST  
FOR THE INSTALLATION OF LONG SPAN STEEL TRUSSES**  
(For Trusses exceeding 20m in Clear Span)

This checklist is to provide assistance to the S.O./Supervising Engineer prior to the commencement of any installation of long span steel roof trusses. Please tick and indicate whether all the items / conditions have been adhered fully.

No	ITEM	Compliance (✓)
A	<b>DOCUMENTATIONS</b>	
A1	Approved Structural Drawings by the Designer	
A1.1	For JKR's in house design, the drawings must be approved and signed by the HODT.	
A1.2	For design by Consultants, all drawings must be approved and endorsed by the submitting Professional Engineer.	
A2	Shop drawings for erection purposes <i>issued</i> by the Steel Installer	
A2.1	The Professional Engineer (PE) appointed by the Steel Installer must ensure that, these shop drawings are in accordance to the design and any assumptions made for the design. Any additional joints/splicing and any other deviations required for the purpose of erections must be accompanied by the calculations and approved by this Professional Engineer.	
A2.2	Quality Assurance documentations for the fabrication of steel members must be approved by the PE appointed by the Steel Installer.	
A2.3	Competency certification from approved establishment for all erection supervisors and installers.	

**SECTION J: STRUCTURAL STEEL  
AND METALWORKS**

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : : 02 Januari 2020  
Muka Surat : J/8

B.	METHODOLOGY	
B1	<p>The Contractor shall prepare and submit the Method Statement to the S.O. for approval at least three (3) weeks prior to the erection commencement.</p> <p>A copy of the Method Statement must be submitted to the Designer's office for verification.</p>	
B2	<p>The Method Statement with the concurrence of the Designer shall be approved by the S.O..</p> <p>(Item 12.4, Section A, <i>Standard Specification of Building Works, 2014</i>)</p>	
B3	<p>The Method Statement shall among others include the following:</p>	
B3.1	Pre-erection survey and formal acceptance of site	
B3.2	Phased component delivery (if any)	
B3.3	Safety and environmental controls	
B3.4	Operative certification	
B3.5	Plant and equipment certification	
B3.6	<p>Detailed Sequencing of Installation, and showing the movements of any plant/machinery required for the installation.</p> <p><b>The installation sequencing must be divided into several major/critical stages for the purpose of verification.</b></p>	
B3.7	Quality Assurance documentations required for the installation	
B4	Erection must adhere fully to the Method Statement. Each stages of erection must be verified and approved by the Supervising Engineer or the S.O..	

**SECTION J: STRUCTURAL STEEL  
AND METALWORKS**

No. Dokumen : JKR 20800-0226-20  
No. Keluaran : 01  
No. Pindaan : 00  
Tarikh : : 02 Januari 2020  
Muka Surat : J/9

<b>C. SAFETY</b>	
C1	All internal or external temporary bracings required for the installation must be designed and approved by the P.E. appointed by the Steel Installer.
C2	All temporary bracings must be shown in the Shop Drawings.
C3	The Contractor shall prepare plan showing width and level of access, level of prepared working area for site traffic and plant movements, and areas available for temporary storage.
C4	Unless required and approved by the S.O. otherwise, all welding works shall to be done at ground level.
<b>D CERTIFICATION OF COMPLETION</b>	
D1	The Contractor shall certify that he/she has made all the necessary inspections to ensure all steelworks and the corresponding connections has been erected and constructed in accordance with the work's drawings, specification and contract requirements.

**Saya telah menyemak dan bersetuju**

.....  
**(Cop & Tandatangan oleh S.O./Wakil S.O.)**

**Tarikh .....**

**REKOD PENGALAMAN KERJA  
DALAM 5 TAHUN LEPAS –  
BORANG D**

**BORANG D – REKOD PENGALAMAN KERJA PENYEBUTHARGA**  
 (Senarai semua kerja yang disiapkan dalam 5 tahun lepas +)

Bil.	Nama	Nilai Kontrak (RM)	Nilai Penyebutharga* Bertanggungjawab	Tempoh Kontrak **	Tarikh Siap		Nama dan Alamat Pengguna/Jurutera Perunding	Nama Majikan
					Tarikh Milik Tapak	Kontrak		

- + Salinan Perakuan/Pengesahan Siap Kerja bagi setiap kerja yang disenaraikan hendaklah disertakan.
- \* Hanya perlu diisi sekiranya penyebutharga melaksanakan kerja sebagai ahli syarikat gabungan.
- \*\* Tempoh kontrak hendaklah termasuk lanjutan masa yang diluluskan.

---

# **SENARAI KAKITANGAN TEKNIKAL - BORANG E**

**BORANG E – KAKITANGAN TEKNIKAL**  
 (Butir-butir Kakitangan Teknikal Yang Ada Dalam Penggajian Penyebutharga Masa Kini)

*Nama dan No. K/P	Umur	Kelulusan Profesional/ Pendidikan**	Tahun Kelulusan	Tarikh Diambil Bekerja	Jawatan yang Disandang/ Tugas-Tugas semasa	Pengalaman Lepas (Jawatan disandang, Nama projek dan majikan dan tempoh Bekerja dan sebagainya
1.						
2.						
3.						
4.						
5.						
6.						
7.						
8.						
9.						
10.						

\* Salinan Borang KWSP 'A' setiap pekerja bagi bulan caruman terakhir dan salinan perjanjian perkhidmatan ahli profesional yang diambil khidmat secara kontрак hendaklah disertakan.  
 Sila sertakan salinan Sijil Kelulusan atau Sijil Keahlian Badan-badan Professional

\*\*

---

---

# **SENARAI KEEMPUNYAAN LOJI DAN PERALATAN UTAMA - BORANG F**

**BORANG F – KEEMPUNYAAN LOJI DAN PERALATAN PEMBINAAN UTAMA**  
 (Senarai Loji dan Peralatan Pembinaan Utama kepadaan penyebutharga yang sesuai yang boleh digunakan untuk projek)

Bil.	Butiran (Jenis, model, buatan dan keupayaan/ saiz)	Dimiliki, Disewa-beli Atau Disewapajak*	Bilangan Setiap satu	Nilai Semasa (RM)	Umur (dari tarikh belian asal)	Tempat simpanan/ digunakan sekarang	Catatan
A.	Loji dan Peralatan Asas ** :						
	i) Lorry / Tipper / Dumper / 4x4						
	ii) Sky lift						
B.	Loji dan Peralatan lain :						
	i) Drill and Cutter						
	ii) Welding Machine						
	iii) Pneumatic Jackhammers						

- \* Salinan kad pendaftaran dan/ atau dokumen-dokumen lain bukti keempunyaan hakmilik penyebutharga atau perjanjian sewabeli/ sewapajak atas setiap Loji dan Peralatan yang disenaraikan hendaklah disertakan.  
 Pegawai yang menyediakan Dokumen Sebutharga hendaklah menyenaraikan butiran-butiran Loji dan Peralatan Asas bagi projek berkenaan (tanpa bilangan AKM).
- \*\*

---

# **PRESTASI KERJA SEMASA**

# **BORANG G**

## **BORANG G - SENARAI KERJA/KONTRAK SEMASA PENYEBUTHARGA**

(Senarai semua kerja di dalam tangan/sedang berjalan dan belum siap termasuk kontrak yang baru diawadkan)

Bil	Nama Kontrak/Projek+	Nilai Kontrak (RM)	Nilai Penyebutharga* Bertanggung jawab	Tempoh Kontrak **	Tarikh Milik Tapak	Tarikh Siap Kontrak	Kemajuan Kerja+		Nama dan Alamat Majikan
							Ikut Jadual (%)	Sebenar Dicapai (%)	

\* Hanya perlu diisi sekiranya penyebutharga melaksanakan kerja sebagai ahli syarikat gabungan

\*\* Tempoh Kontrak hendaklah termasuk lanjutan masa yang diluluskan.

+ Peringatan Penting  
Bagi setiap kerja semasa dalam tangan yang disenaraikan, penyebutharga wajib mengemukakan Laporan Penyelia Projek seperti format di Borang GA/GA1.

**SULIT**

**BORANG GA – LAPORAN PENYELIA PROJEK ATAS PRESTASI KERJA (BUKAN PROJEK MSN) SEMASA PENYEBUTHARGA**

(Borang ini hendaklah dilengkapkan oleh Penyelia Projek atau Pembantu Kanannya yang mengawasi projek dan diserahkan kepada Kontraktor dalam satu sampul berlakri untuk disertakan bersama-sama sebutharganya)

Kepada: Pengarah.....  
.....  
(u/p:.....)

Nama Kontraktor: .....  
Nama Projek Yang Dilaksanakan .....

No. Kontrak :

Harga Kontrak (termasuk anggaran nilai kerja perubahan) : RM .....  
Wang Kos Prima dan Peruntukan Sementara : RM .....  
Nilai Kerja Pembina : RM .....

Tarikh Milik Tapak : ..... Tempoh Kontrak: ..... Minggu  
Tarikh Penyiapan Asal : .....

Lanjutan Masa Yang Telah Diluluskan : ..... hari

Lanjutan Masa Seterusnya:  
Yang difikir/ dijangka layak diperakukan : ..... hari  
Atas Sebab-sebab : (i) .....  
(ii) .....

Kemajuan Kerja (berdasarkan nilai kerja yang telah dilaksanakan):

Pencapaian sebenar: ..... % Mengikut Jadual: ..... %  
Tarikh Kerja dijangka akan dapat disiapkan: .....

Nilai Bahagian Kerja Yang Telah Siap : RM .....  
Nilai Baki Kerja Yang Belum Siap : RM .....

Ulasan-ulasan mengenai Prestasi Kontraktor:

(Nyatakan apa-apa kepujian dan/ atau kelemahan kontraktor dan juga apa-apa tindakan/ perakuan yang diambil/ dipertimbang berhubung dengan prestasi Kontraktor melaksanakan Kontrak)

Tandatangan Penyelia Projek : .....

Nama : .....  
Jawatan : ..... Tarikh: .....

**SULIT**

**BORANG GA1 – LAPORAN JURUTERA PROJEK ATAS PRESTASI KERJA SEMASA PENYEBUTHARGA**

(Borang ini hendaklah dilengkapkan oleh Jurutera Projek atau Pembantu Kanannya yang mengawasi projek apabila diminta berbuat demikian oleh Pegawai Penilaian dan hendaklah dihantar segera dengan menggunakan mesin Fax/Email)

Kepada: Pengarah.....  
.....  
.....  
(u/p:.....)

Nama Kontraktor: .....  
Nama Projek Yang Dilaksanakan .....

No. Kontrak :

Harga Kontrak (termasuk anggaran nilai kerja perubahan) : RM .....  
Wang Kos Prima dan Peruntukan Sementara : RM .....  
Nilai Kerja Pembina : RM .....

Tarikh Milik Tapak : ..... Tempoh Kontrak: ..... minggu  
Tarikh Penyiapan Asal : .....

Lanjutan Masa Yang Telah Diluluskan : ..... hari

Lanjutan Masa Seterusnya:  
Yang difikir/ dijangka layak diperakukan : ..... hari  
Atas Sebab-sebab : (i) .....  
(ii) .....

Kemajuan Kerja (berdasarkan nilai kerja yang telah dilaksanakan):  
Pencapaian sebenar: ..... % Mengikut Jadual: ..... %  
Tarikh Kerja dijangka akan dapat disiapkan: .....

Nilai Bahagian Kerja Yang Telah Siap : RM .....  
Nilai Baki Kerja Yang Belum Siap : RM .....

Ulasan-ulasan mengenai Prestasi Kontraktor:  
(Nyatakan apa-apa kepujian dan/ atau kelemahan kontraktor dan juga apa-apa tindakan/ perakuan yang diambil/ dipertimbang berhubung dengan prestasi Kontraktor melaksanakan Kontrak)

Tandatangan Pegawai Penguasa/  
Jurutera Projek/ Wakilnya : .....

Nama : .....  
Jawatan : ..... Tarikh: .....

---

# **SENARAI SUB-KONTRAKTOR**

## **PAKAR - BORANG H**

**BORANG H**

**SENARAI SUB KONTRAKTOR UNTUK KERJA PAKAR  
(PEMBUAT / PEMBEKAL)**

SUB KONTRAKTOR DAN PEMBEKAL YANG DINIATKAN UNTUK KONTAK INI			
Penyebutharga hendaklah menyenaraikan nama-nama sub-kontraktor yang dicadangkan.			
No.	Bidang Kerja dan Maklumat Am Kontraktor Pakar	Pendaftaran Dengan CIDB (Gred / Kategori / Pengkhususan)	Pendaftaran Dengan Lain-Lain Jabatan Berkaitan / MOF
<b>1</b>	<b>Skop Pembekalan</b> a) Jenis Skop : b) Nama Pembekal : c) Alamat Pembekal :		
<b>2</b>	<b>Pembuat Pakar</b> a) Jenis Skop Kerja : b) Nama Pembuat : c) Alamat Pembuat :		
<b>3</b>	d) Profit Produk : e) Profit Projek Dilaksanakan : f) Sample :  (wajib dikemukakan bersama dengan dokumen sebutharga)		
<b>3</b>	Pengesahan daripada sub-kontraktor pakar.  Kami dengan ini mengesahkan bahawa penyebutharga telah mendapat maklumat kos dan kaedah pembinaan produk kami dan kami bersetuju untuk melaksanakan kerja ini untuk pihak Kerajaan.	(Tandatangan)	Cop Syarikat :
	Nama : No. KP : Jawatan : Tarikh :		

Nota :

- 1 Sekiranya kontraktor gagal mengemukakan pengesahan daripada pembekal / pembuat pakar. Sebutharga kontraktor boleh tidak dipertimbangkan oleh Jawatankuasa berkaitan
- 2 Sekiranya sub-kontraktor pakar gagal untuk meyakinkan pihak Kerajaan tentang kualiti daya tahan dan pematuhan kepada syarat yang ditetapkan, kontraktor hendaklah bersetuju untuk menggunakan produk dan perkhidmatan sub-kontraktor pakar yang lain dengan tiada tambahan kos kepada kontrak

LIST OF SPECIALIST SUB-CONTRACTORS TO BE ENGAGED IN THIS PROJECT

NAME AND ADDRESS OF SUB-CONTRACTORS	REGISTRATION WITH CIDB / MOF (Submit copies of relevant registration)	TYPE OF WORK UNDERTAKEN	YEARS OF EXPERIENCE